

Richmond Water Resources Department

VERMONT GROUNDWATER SYSTEM #5084 DAILY TEST RESULTS Month

Apr-26

Date	Meter	gallons produced	Finished Water Entering System			Endyne FL Result
			FL Lev	Entry Point Free CL2	PH Out	On Date Sampled
Sample Location			Waterhouse Tap	Waterhouse Tap	Waterhouse Tap	From The
Target Range			0.6 - 1.0 mg/L	0.8 - 4.0 mg/L	Minimum of 7.0	0.6-1.0 mg/L
Mar. 31 #->	29,050,500					
1	29,149,800	99,300	0.69	1.22	7.42	0.77
2	29,156,400	6,600	0.71	1.14	7.43	
3	29,258,400	102,000	0.75	1.20	7.43	
4	29,276,900	18,500	0.68	1.09	7.43	
5	29,359,800	82,900	0.74	1.25	7.45	
6	29,383,200	23,400	0.87	1.09	7.44	
7	29,383,900	700	0.8	1.11	7.44	0.79
8	29,509,200	125,300	0.72	1.24	7.47	
9	29,509,200	0	0.7	1.17	7.47	
10	29,623,700	114,500	0.69	1.19	7.39	
11	29,626,400	2,700	0.98	1.05	7.39	
12	29,726,600	100,200	0.75	1.14	7.41	
13	29,726,600	0	0.66	1.10	7.4	
14	29,788,500	61,900	0.71	1.16	7.33	
15	29,842,300	53,800	0.64	1.19	7.35	
16	29,856,300	14,000	0.65	0.97	7.38	
17	29,971,900	115,600	0.66	1.16	7.33	
18	29,971,900	0	0.69	1.09	7.34	
19	30,073,900	102,000	0.64	1.17	7.36	
20	30,073,900	0	0.65	1.05	7.38	
21	30,131,100	57,200	0.66	1.26	7.45	
22	30,298,700	167,600	0.68	1.22	7.42	
23	30,298,700	0	0.7	1.25	7.37	
24	30,381,000	82,300	0.66	1.20	7.38	
25	30,381,000	0	0.68	1.19	7.41	
26	30,482,000	101,000	0.65	1.20	7.36	
27	30,482,000	0	0.68	1.15	7.33	
28	30,537,800	55,800	0.65	1.24	7.33	
29	30,594,200	56,400	0.65	1.21	7.3	
30	30,595,100	900	0.65	1.08	7.31	
Total		1,544,600				
Ave.		49,826	0.70	1.16	7.39	0.78
Max.		167,600	0.98	1.26	7.47	0.79

Vermont Monthly Operations Report For Groundwater Systems
And Systems Purchasing Groundwater

April

2026

Name of System: Richmond Water Resources Department

WSID # : 5084 Town : Richmond

Erin Kelley, Operator in Training, Phone work--> (802) 316-7559

A master meter is installed and functioning which records daily production

All water quality compliance analysis results have been reported to the Water Supply Division.

See attached for production information and results of daily parameter testing.

I certify, as the owner or authorized representative of this Water System, that I have completed this form, or reviewed it if completed by another, and that I have taken the necessary steps to ensure the information shown is correct. In making this certification, I understand that civil and/or criminal penalties may be imposed for submitting false information.

Prepared by Erin Kelley, Water Operator in Training, #OP05524


Signature *Erin Kelley* Date 05/06/2026

Approved by Josh Arneson, Richmond Town Manager and Authorized Representative

Signature *Josh Arneson* Date 5/6/2026


Notes:

Fluoride in mg/L for April 2026

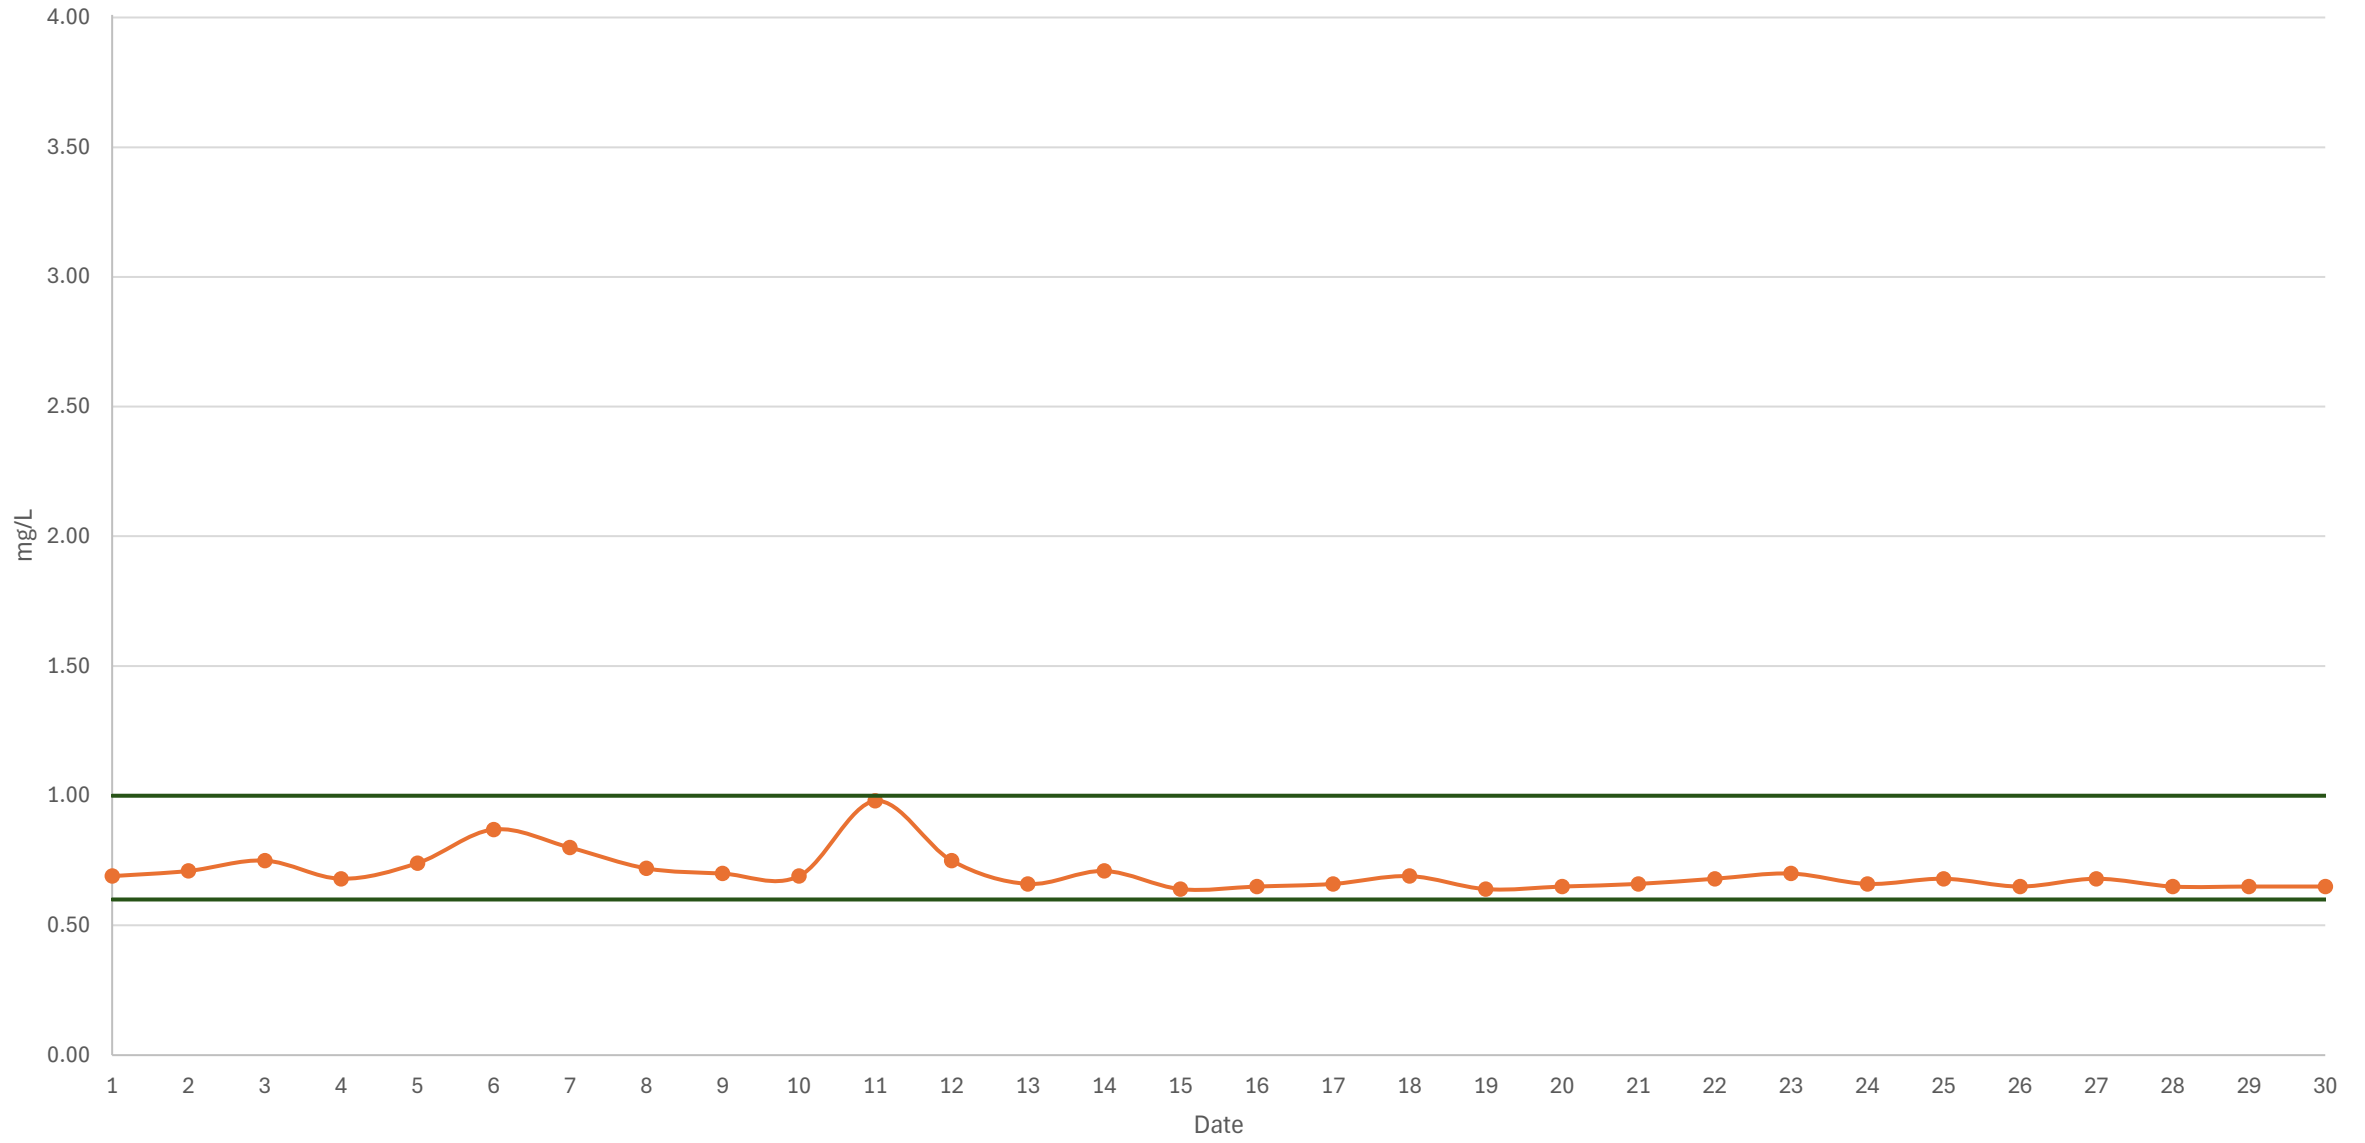

—●— Fluoride — Fluoride permitted min (0.6) and max (1.0)

System Free Chlorine in mg/L for April 2026

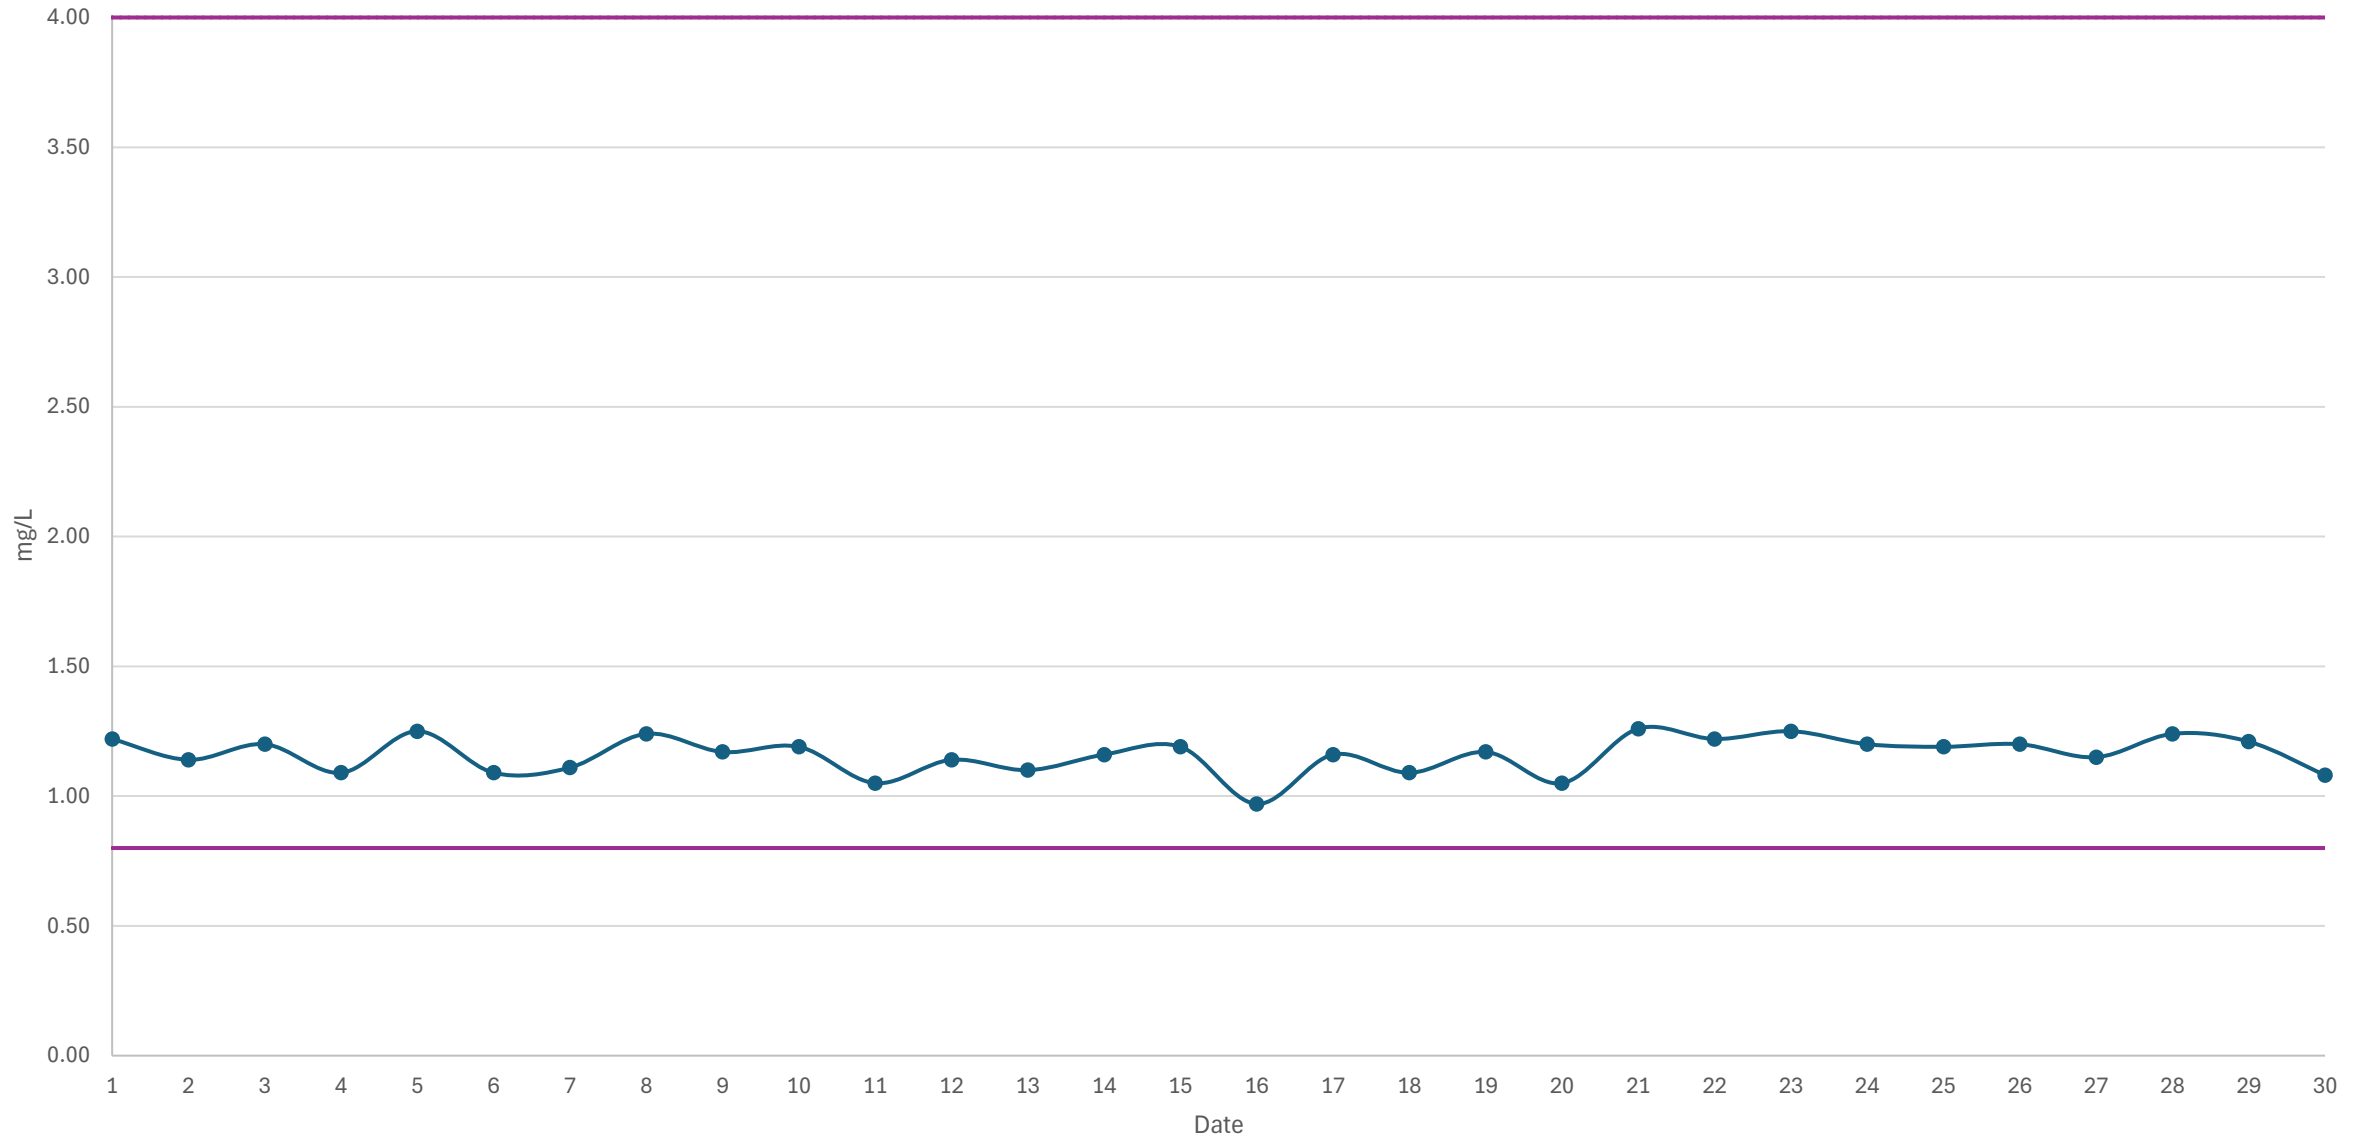

System Free Chlorine Chlorine permitted min (0.8) and max (4.0)

Waterhouse pH April 2026

