

Richmond Water Resources Department
VERMONT GROUNDWATER SYSTEM #5084 DAILY TEST RESULTS Month **Jul-26**

		gallons produced	Finished Water Entering System			Endyne FL Result
Date	Meter		FL Lev	Entry Point Free CL2	PH Out	On Date Sampled
Sample Location			Waterhouse Tap	Waterhouse Tap	Waterhouse Tap	From The
						Waterhouse Tap
Target Range			0.6 - 1.0 mg/L	0.8 - 4.0 mg/L	Minimum of 7.0	0.6-1.0 mg/L
June 30 #->	33,841,200					
1	33,841,200	0	0.74	1.32	7.33	0.7
2	33,935,400	94,200	0.74	1.43	7.26	
3	33,953,800	18,400	0.66	0.75	7.29	
4	34,046,900	93,100	0.66	1.65	7.27	
5	34,068,900	22,000	0.62	1.46	7.29	
6	34,130,400	61,500	0.69	1.34	7.31	
7	34,181,000	50,600	0.68	1.19	7.30	
8	34,219,600	38,600	0.71	1.33	7.33	
9	34,302,800	83,200	0.71	1.22	7.29	0.66
10	34,302,800	0	0.70	1.07	7.31	
11	34,400,300	97,500	0.70	1.17	7.32	
12	34,400,300	0	0.64	0.98	7.33	
13	34,465,300	65,000	0.69	1.25	7.33	
14	34,521,100	55,800	0.72	1.16	7.31	
15	34,626,300	105,200	0.71	1.33	7.27	
16	34,781,400	155,100	0.76	1.38	7.33	
17	34,915,700	134,300	0.76	1.42	7.36	
18	34,934,600	18,900	0.68	1.24	7.37	
19	35,020,600	86,000	0.78	1.37	7.35	
20	35,034,700	14,100	0.71	1.33	7.36	
21	35,093,600	58,900	0.83	1.39	7.36	
22	35,172,300	78,700	0.84	1.31	7.34	
23	35,213,100	40,800	0.91	1.37	7.36	
24	35,281,600	68,500	0.86	1.37	7.38	
25	35,290,700	9,100	0.89	1.18	7.39	
26	35,376,600	85,900	0.91	1.24	7.36	
27	35,392,100	15,500	0.93	1.20	7.36	
28	35,441,500	49,400	0.91	1.38	7.35	
29	35,501,900	60,400	0.86	1.27	7.35	
30	35,501,900	0	0.80	1.06	7.37	
31	35,615,200	113,300	0.89	1.36	7.36	
Total		1,774,000				
Ave.		57,226	0.76	1.27	7.33	0.68
Max.		155,100	0.93	1.65	7.39	0.70
Min		0	0.62	0.75	7.26	0.66

Vermont Monthly Operations Report For Groundwater Systems
And Systems Purchasing Groundwater

July

2026

Name of System: Richmond Water Resources Department

WSID # : 5084 Town : Richmond

Erin Kelley, Operator, Phone work-> 802 316 7559

A master meter is installed and functioning which records daily production

All water quality compliance analysis results have been reported to the Water Supply Division.

See attached for production information and results of daily parameter testing.

I certify, as the owner or authorized representative of this Water System, that I have completed this form, or reviewed it if completed by another, and that I have taken the necessary steps to ensure the information shown is correct. In making this certification, I understand that civil and/or criminal penalties may be imposed for submitting false information.

Prepared by Erin S. Kelley, Class 3 Public Water System Operator # OP05524


Signature Erin Kelley Date 7/31/26

Approved by Josh Arneson, Richmond Town Manager and Authorized Representative


Signature Josh Arneson Date 7/31/26

Notes:

Fluoride in mg/L for July 2026

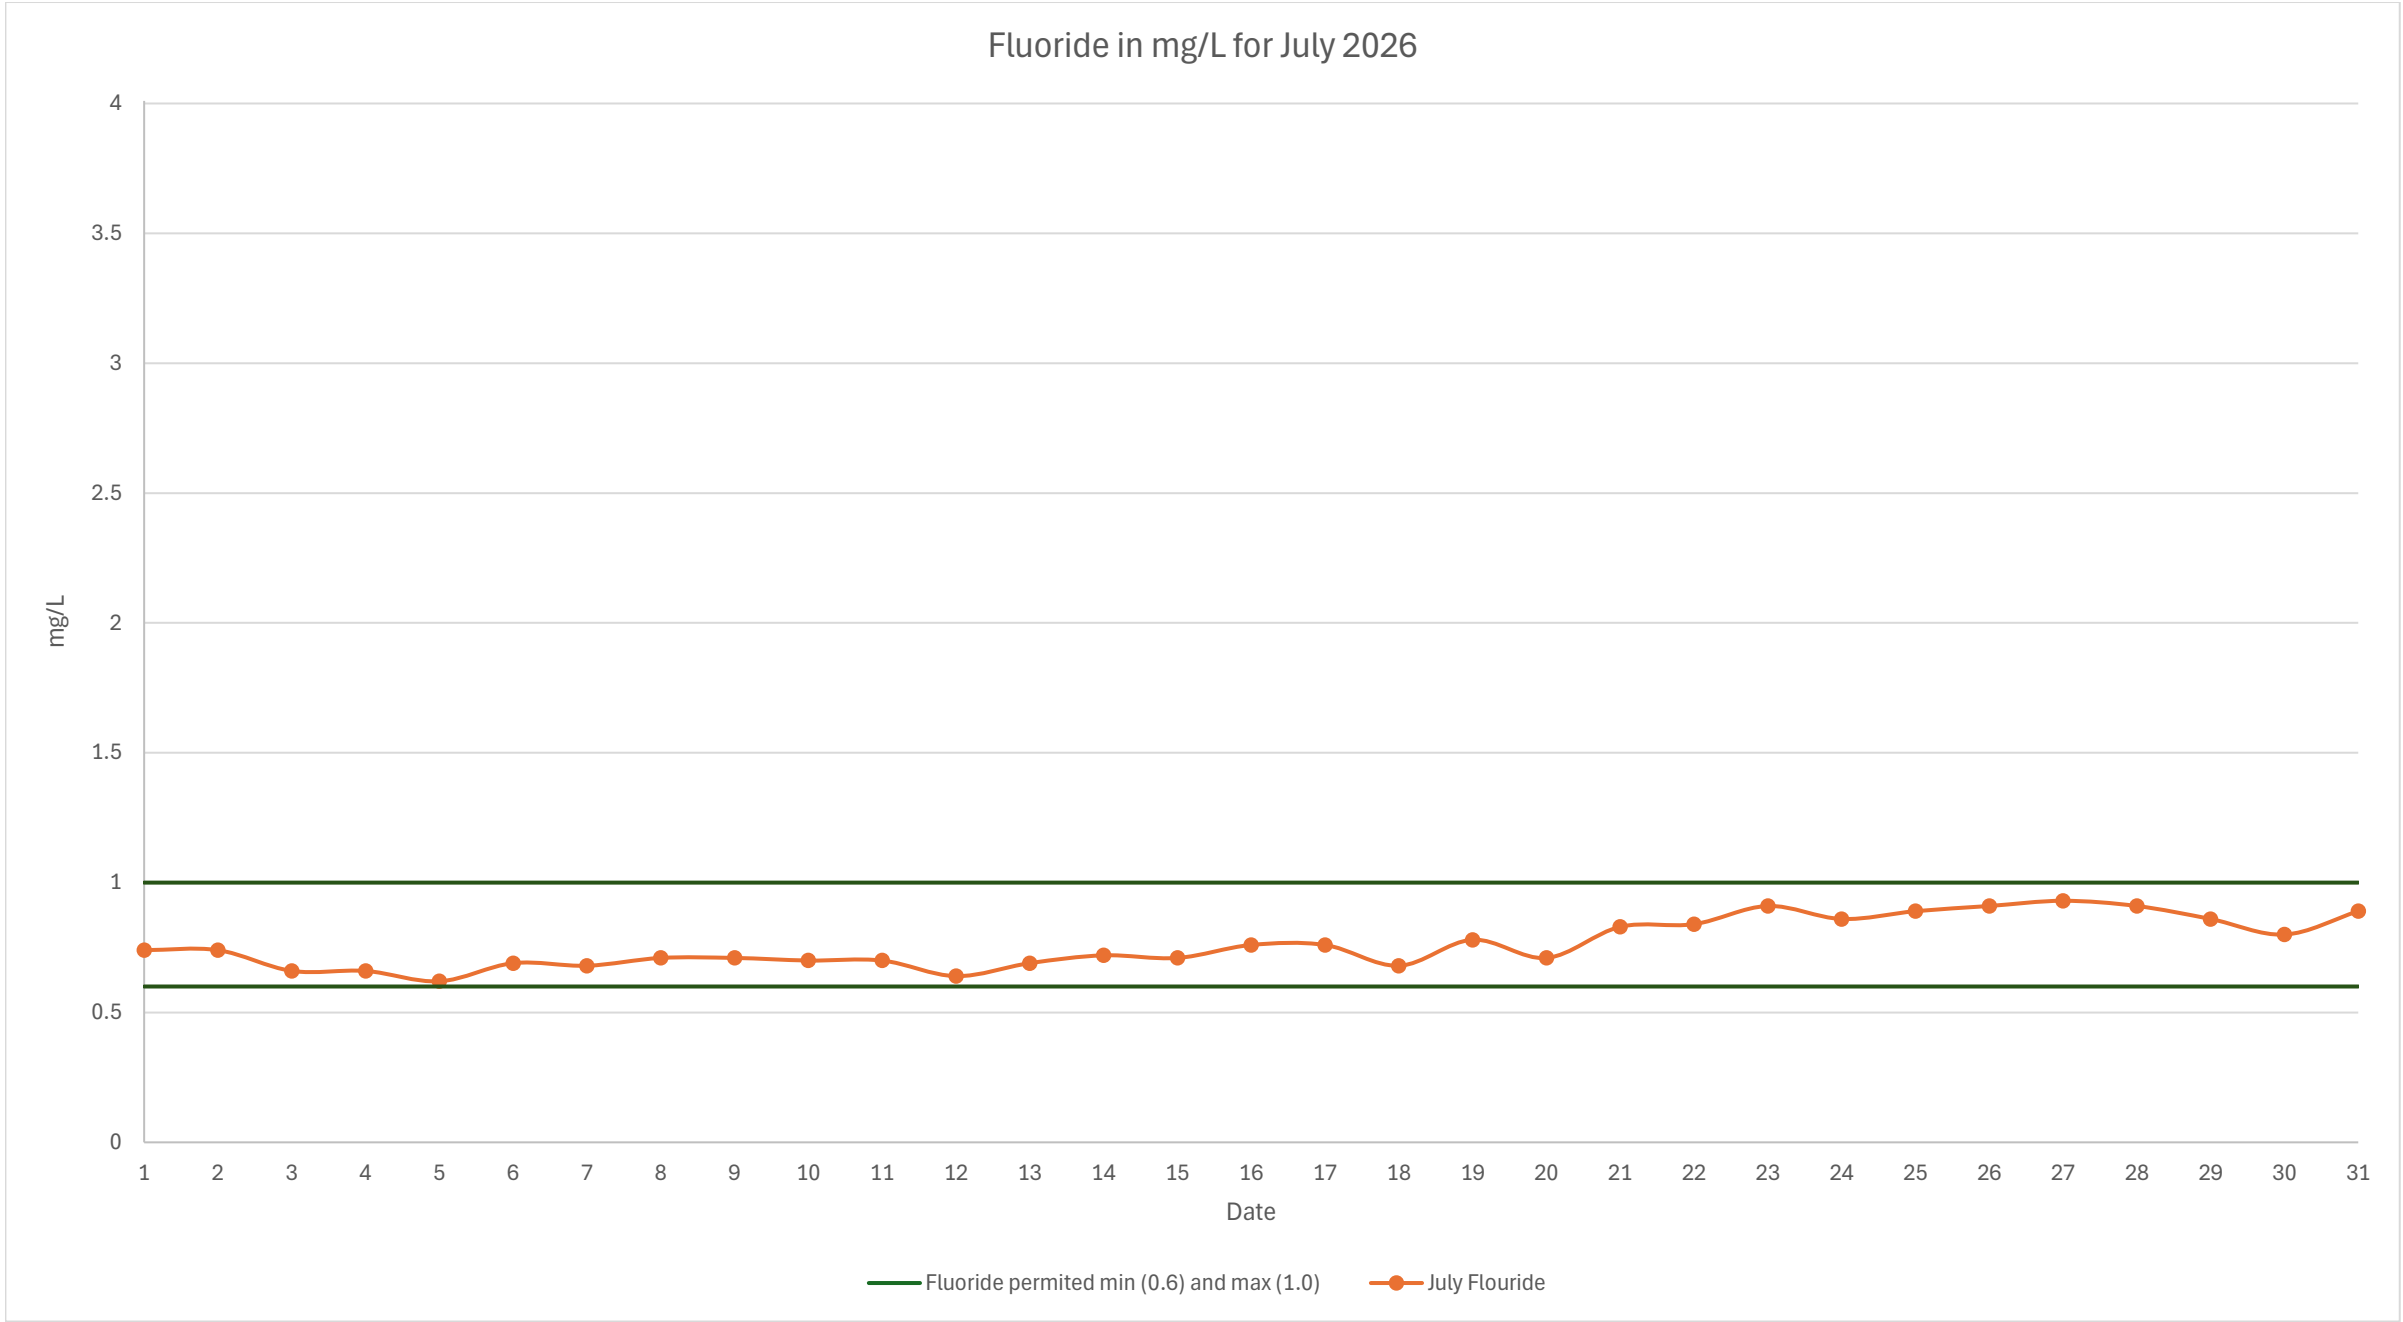

System Free Chlorine in mg/L for July 2026

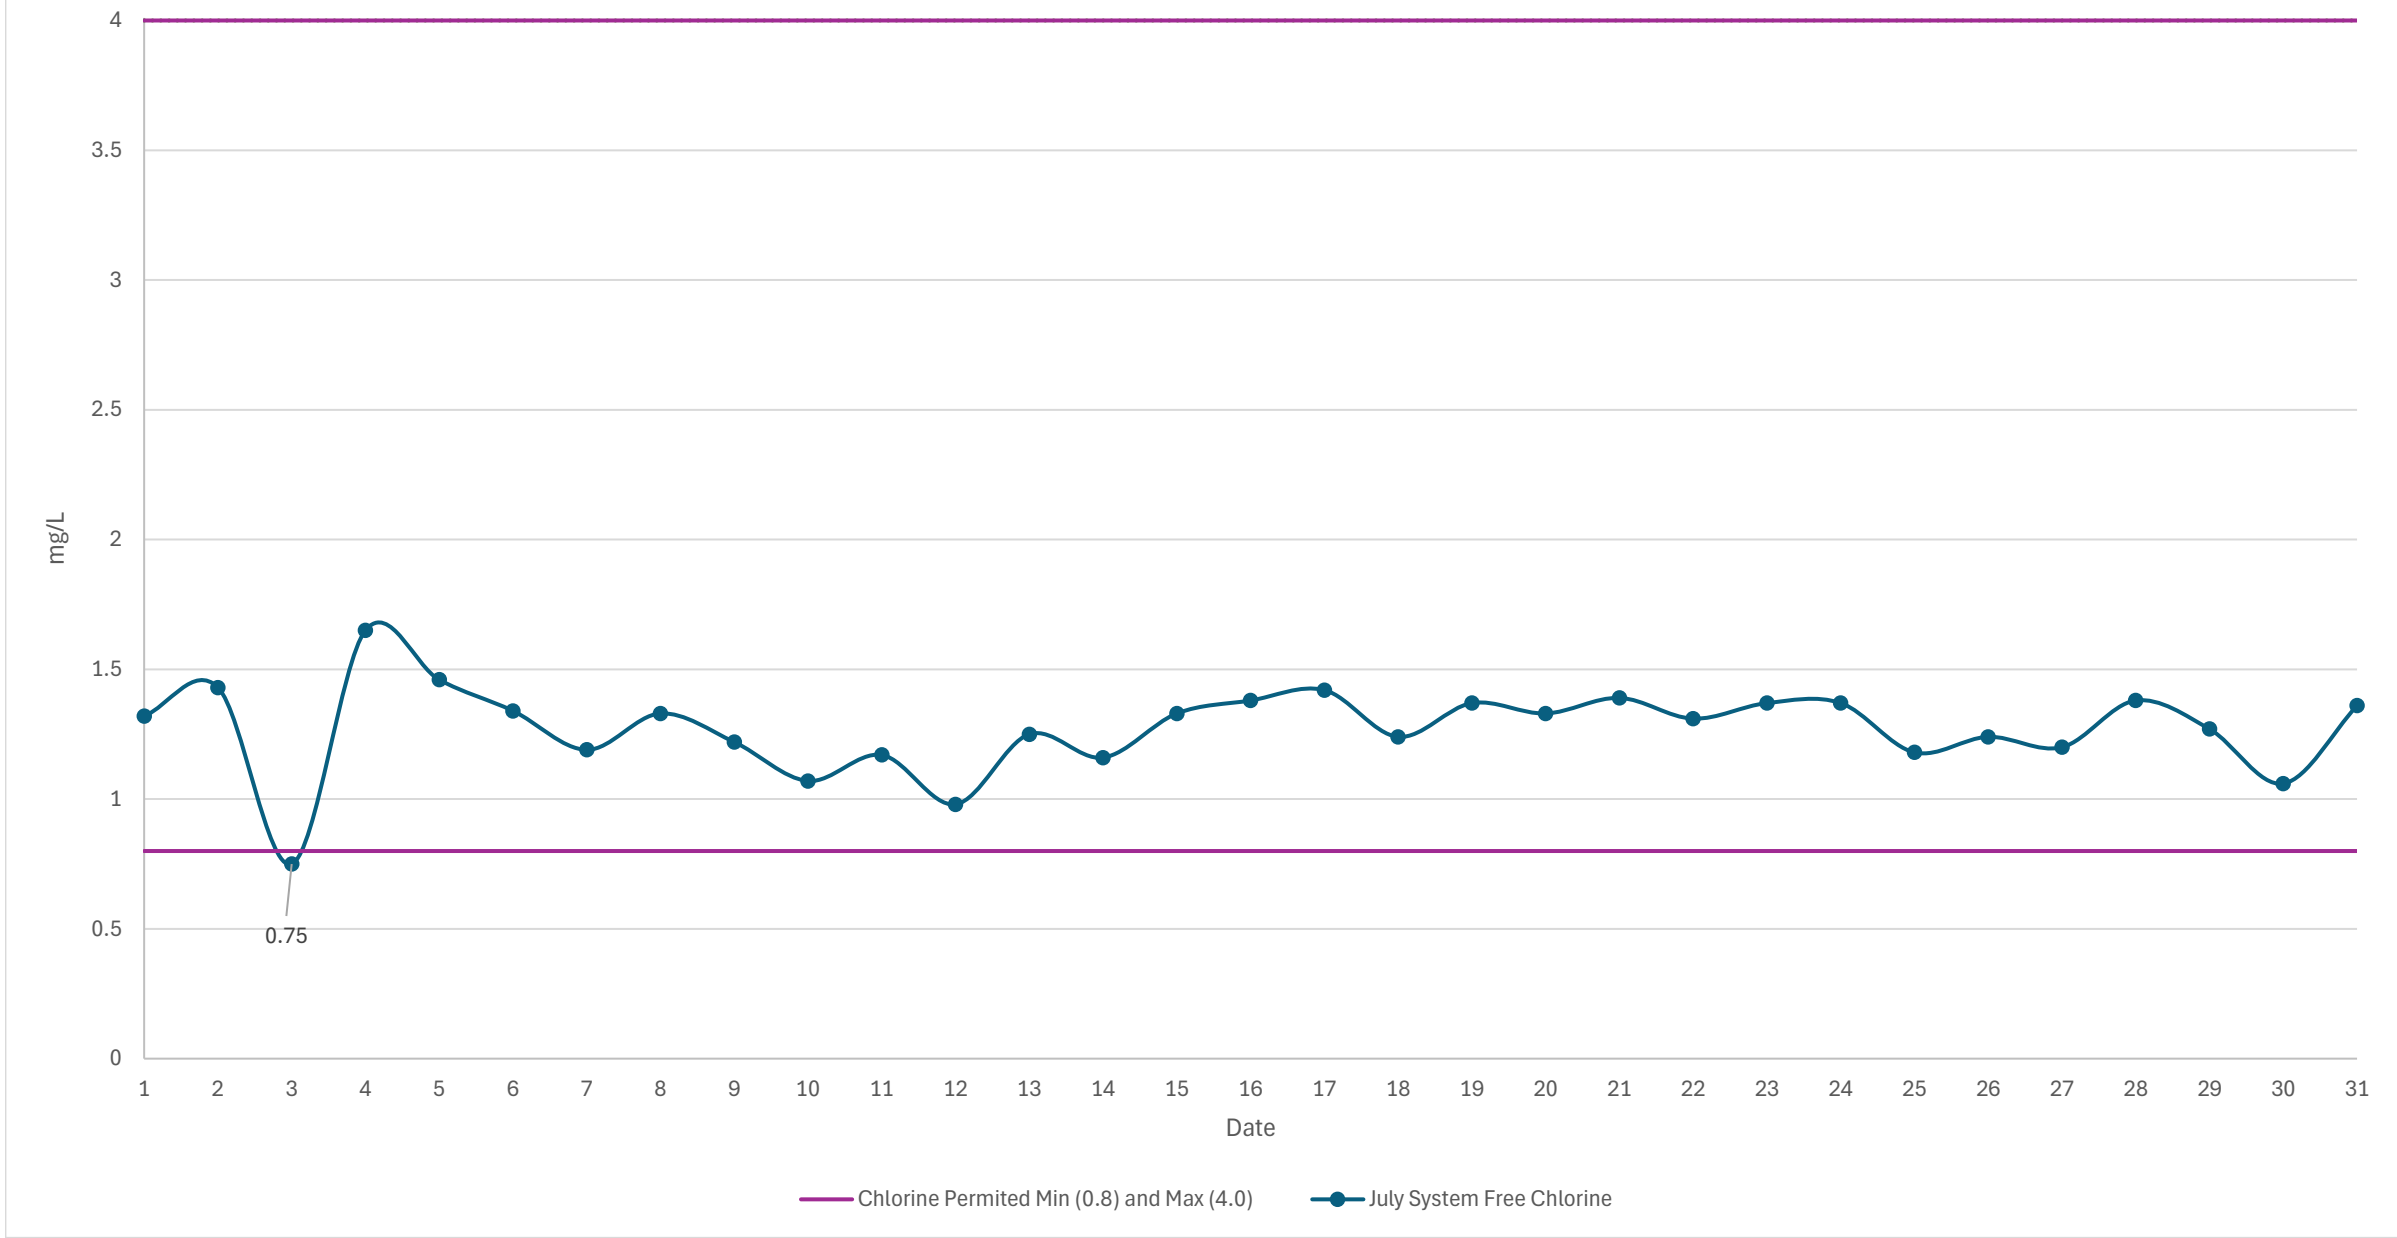

Waterhouse pH July 2026

