

Vermont Monthly Operations Report For Groundwater Systems
And Systems Purchasing Groundwater

March

2026

Name of System: Richmond Water Resources Department

WSID #: 5084 Town : Richmond

Brad Snow Operator, Phone work--> 434 - 2178 Phone home--> 316-2326


A master meter is installed and functioning which records daily production

All water quality compliance analysis results have been reported to the Water Supply Division.


See attached for production information and results of daily parameter testing.

I certify, as the owner or authorized representative of this Water System, that I have completed this form, or reviewed it if completed by another, and that I have taken the necessary steps to ensure the information shown is correct. In making this certification, I understand that civil and/or criminal penalties may be imposed for submitting false information.

Prepared by Brad Snow, Class 3 Public Water System Operator # OP05111

Signature  Date 4/2/26

Approved by Josh Arneson, Richmond Town Manager and Authorized Representative


Signature  Date 4/2/26

Notes:

Richmond Water Resources Department
VERMONT GROUNDWATER SYSTEM #5084 DAILY TEST RESULTS Month **Mar-26**


| Date | Meter | gallons produced | Finished Water Entering System | | | Endyne FL Result |
|-----------------|------------|------------------|--------------------------------|----------------------|----------------|------------------|
| | | | FL Lev | Entry Point Free CL2 | PH Out | On Date Sampled |
| Sample Location | | | Waterhouse Tap | Waterhouse Tap | Waterhouse Tap | From The |
| Target Range | | | 0.6 - 1.0 mg/L | 0.8 - 4.0 mg/L | Minimum of 7.0 | 0.6-1.0 mg/L |
| Feb. 28 #-> | 27,460,800 | | | | | |
| 1 | 27,483,900 | 23,100 | 0.75 | 0.89 | 7.42 | |
| 2 | 27,568,700 | 84,800 | 0.7 | 1.38 | 7.5 | |
| 3 | 27,568,700 | 0 | 0.7 | 1.26 | 7.51 | |
| 4 | 27,658,200 | 89,500 | 0.78 | 0.98 | 7.44 | 0.75 |
| 5 | 27,686,700 | 28,500 | 0.77 | 0.99 | 7.43 | |
| 6 | 27,744,600 | 57,900 | 0.78 | 0.87 | 7.44 | |
| 7 | 27,806,300 | 61,700 | 0.82 | 1.09 | 7.4 | |
| 8 | 27,806,300 | 0 | 0.78 | 0.98 | 7.41 | |
| 9 | 27,893,200 | 86,900 | 0.86 | 1.12 | 7.45 | 0.73 |
| 10 | 28,022,600 | 129,400 | 0.79 | 1.02 | 7.45 | |
| 11 | 28,095,500 | 72,900 | 0.8 | 1.07 | 7.42 | |
| 12 | 28,106,300 | 10,800 | 0.82 | 0.81 | 7.5 | |
| 13 | 28,216,600 | 110,300 | 0.83 | 1.05 | 7.52 | |
| 14 | 28,216,600 | 0 | 0.77 | 0.96 | 7.53 | |
| 15 | 28,308,300 | 91,700 | 0.78 | 1.22 | 7.48 | |
| 16 | 28,325,300 | 17,000 | 0.8 | 1.14 | 7.48 | |
| 17 | 28,384,700 | 59,400 | 0.77 | 1.11 | 7.44 | |
| 18 | 28,453,600 | 68,900 | 0.82 | 1.14 | 7.5 | |
| 19 | 28,453,600 | 0 | 0.78 | 1.09 | 7.48 | |
| 20 | 28,573,900 | 120,300 | 0.71 | 1.12 | 7.45 | |
| 21 | 28,588,700 | 14,800 | 0.69 | 1.07 | 7.46 | |
| 22 | 28,655,900 | 67,200 | 0.69 | 1.34 | 7.43 | |
| 23 | 28,694,700 | 38,800 | 0.81 | 1.15 | 7.43 | |
| 24 | 28,694,700 | 0 | 0.83 | 1.21 | 7.43 | |
| 25 | 28,818,400 | 123,700 | 0.8 | 1.13 | 7.43 | |
| 26 | 28,820,300 | 1,900 | 0.75 | 1.05 | 7.43 | |
| 27 | 28,901,300 | 81,000 | 0.73 | 1.15 | 7.42 | |
| 28 | 28,936,400 | 35,100 | 0.7 | 1.04 | 7.45 | |
| 29 | 28,956,800 | 20,400 | 0.73 | 1.1 | 7.44 | |
| 30 | 29,050,500 | 93,700 | 0.68 | 1.07 | 7.44 | |
| 31 | 29,050,500 | 0 | 0.65 | 1.11 | 7.43 | |
| Total | | 1,589,700 | | | | |
| Ave. | | 51,281 | 0.77 | 1.09 | 7.45 | 0.74 |
| Max. | | 129,400 | 0.86 | 1.38 | 7.53 | 0.75 |
| Min | | 0 | 0.68 | 0.81 | 7.40 | 0.73 |

Fluoride in mg/L for March 2026

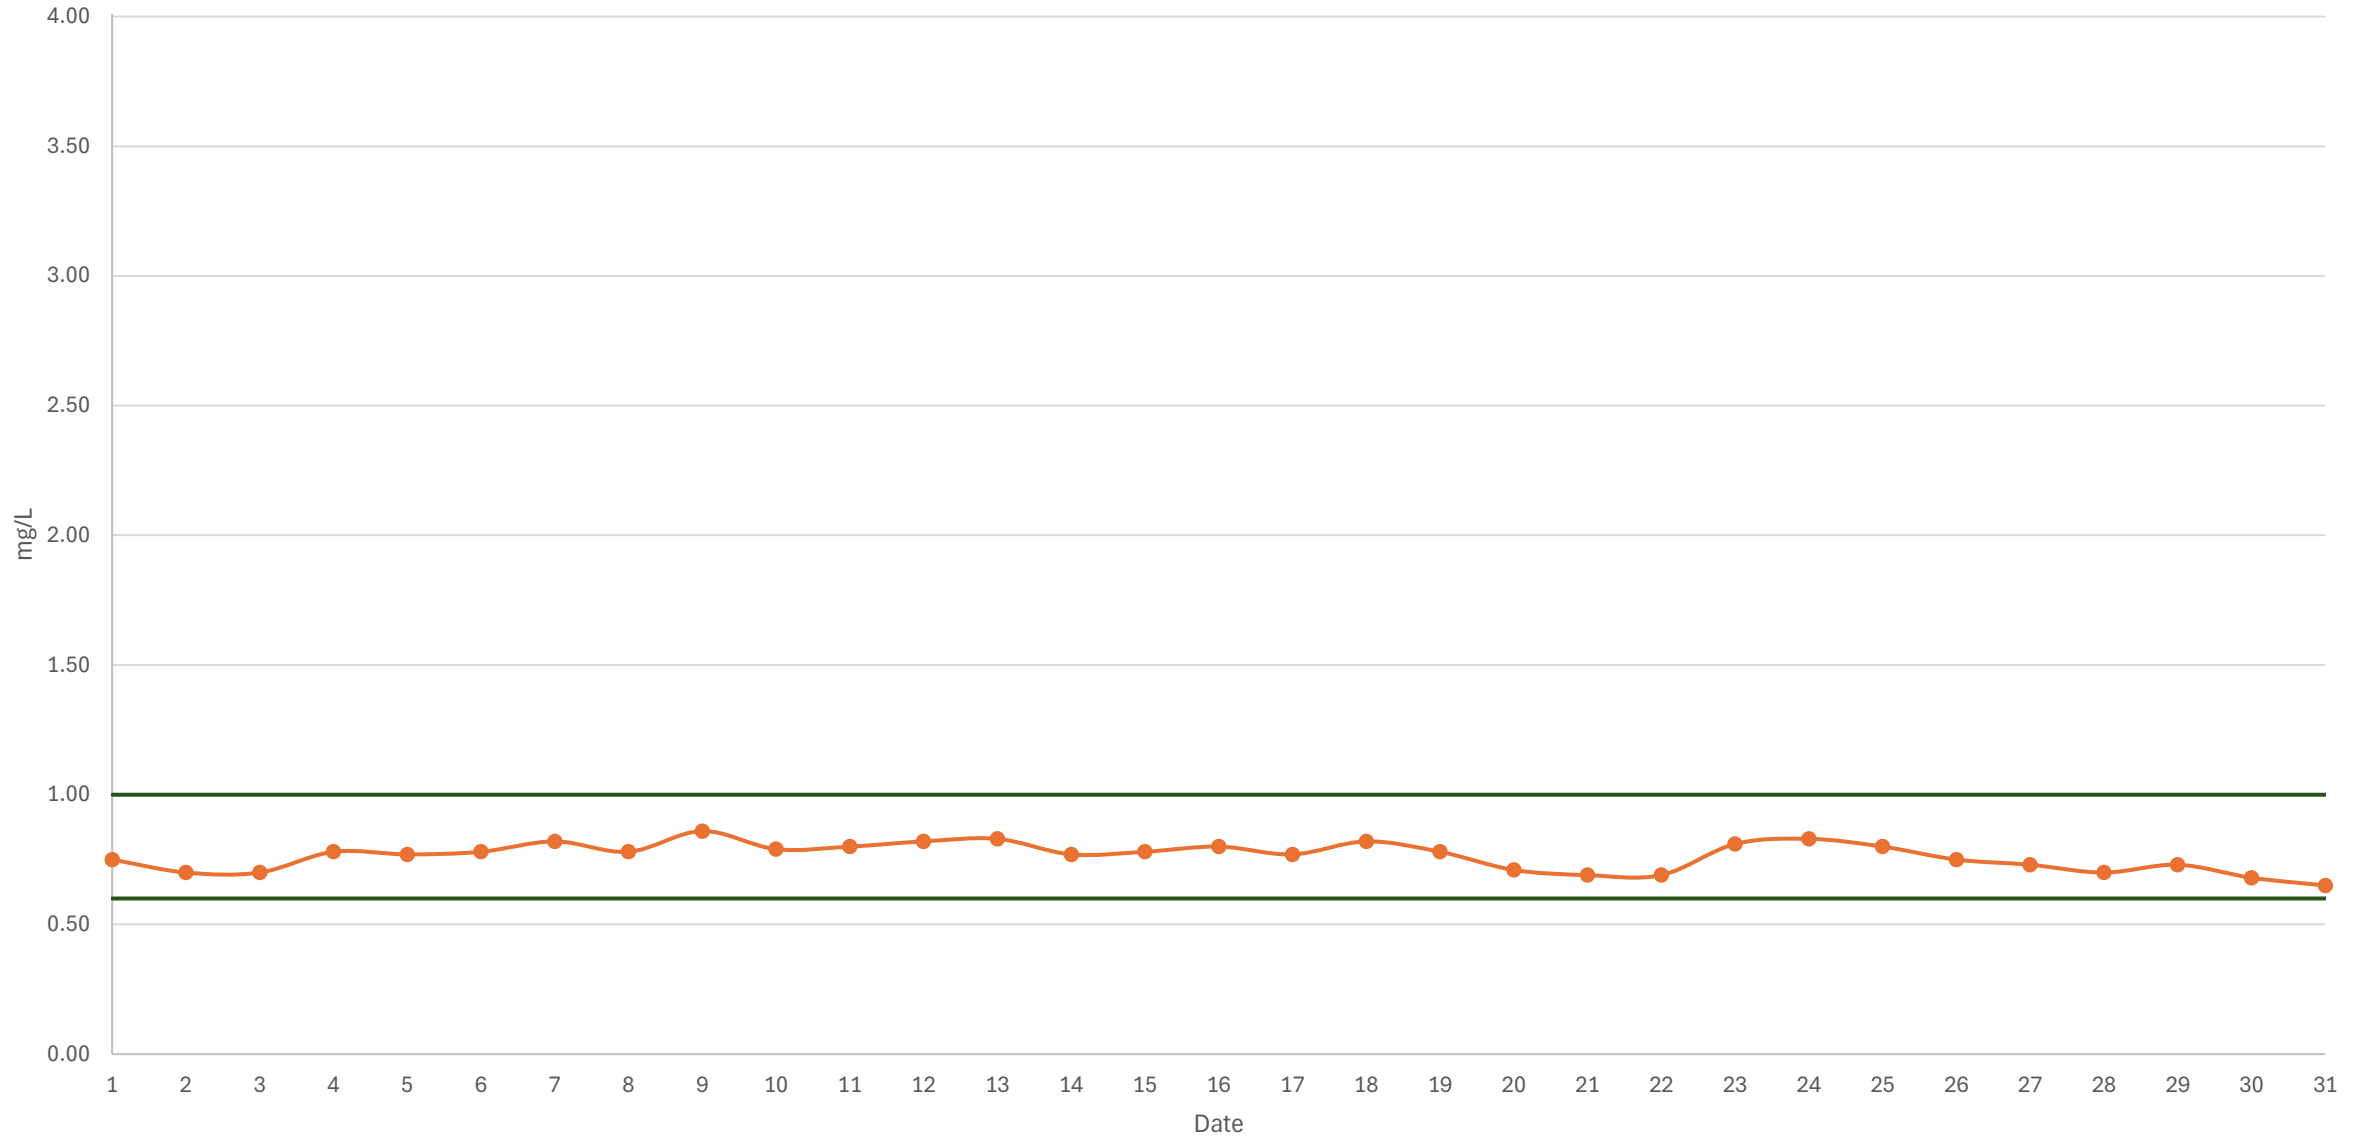

—●— Fluoride — Fluoride permitted min (0.6) and max (1.0)

System Free Chlorine in mg/L for March 2026

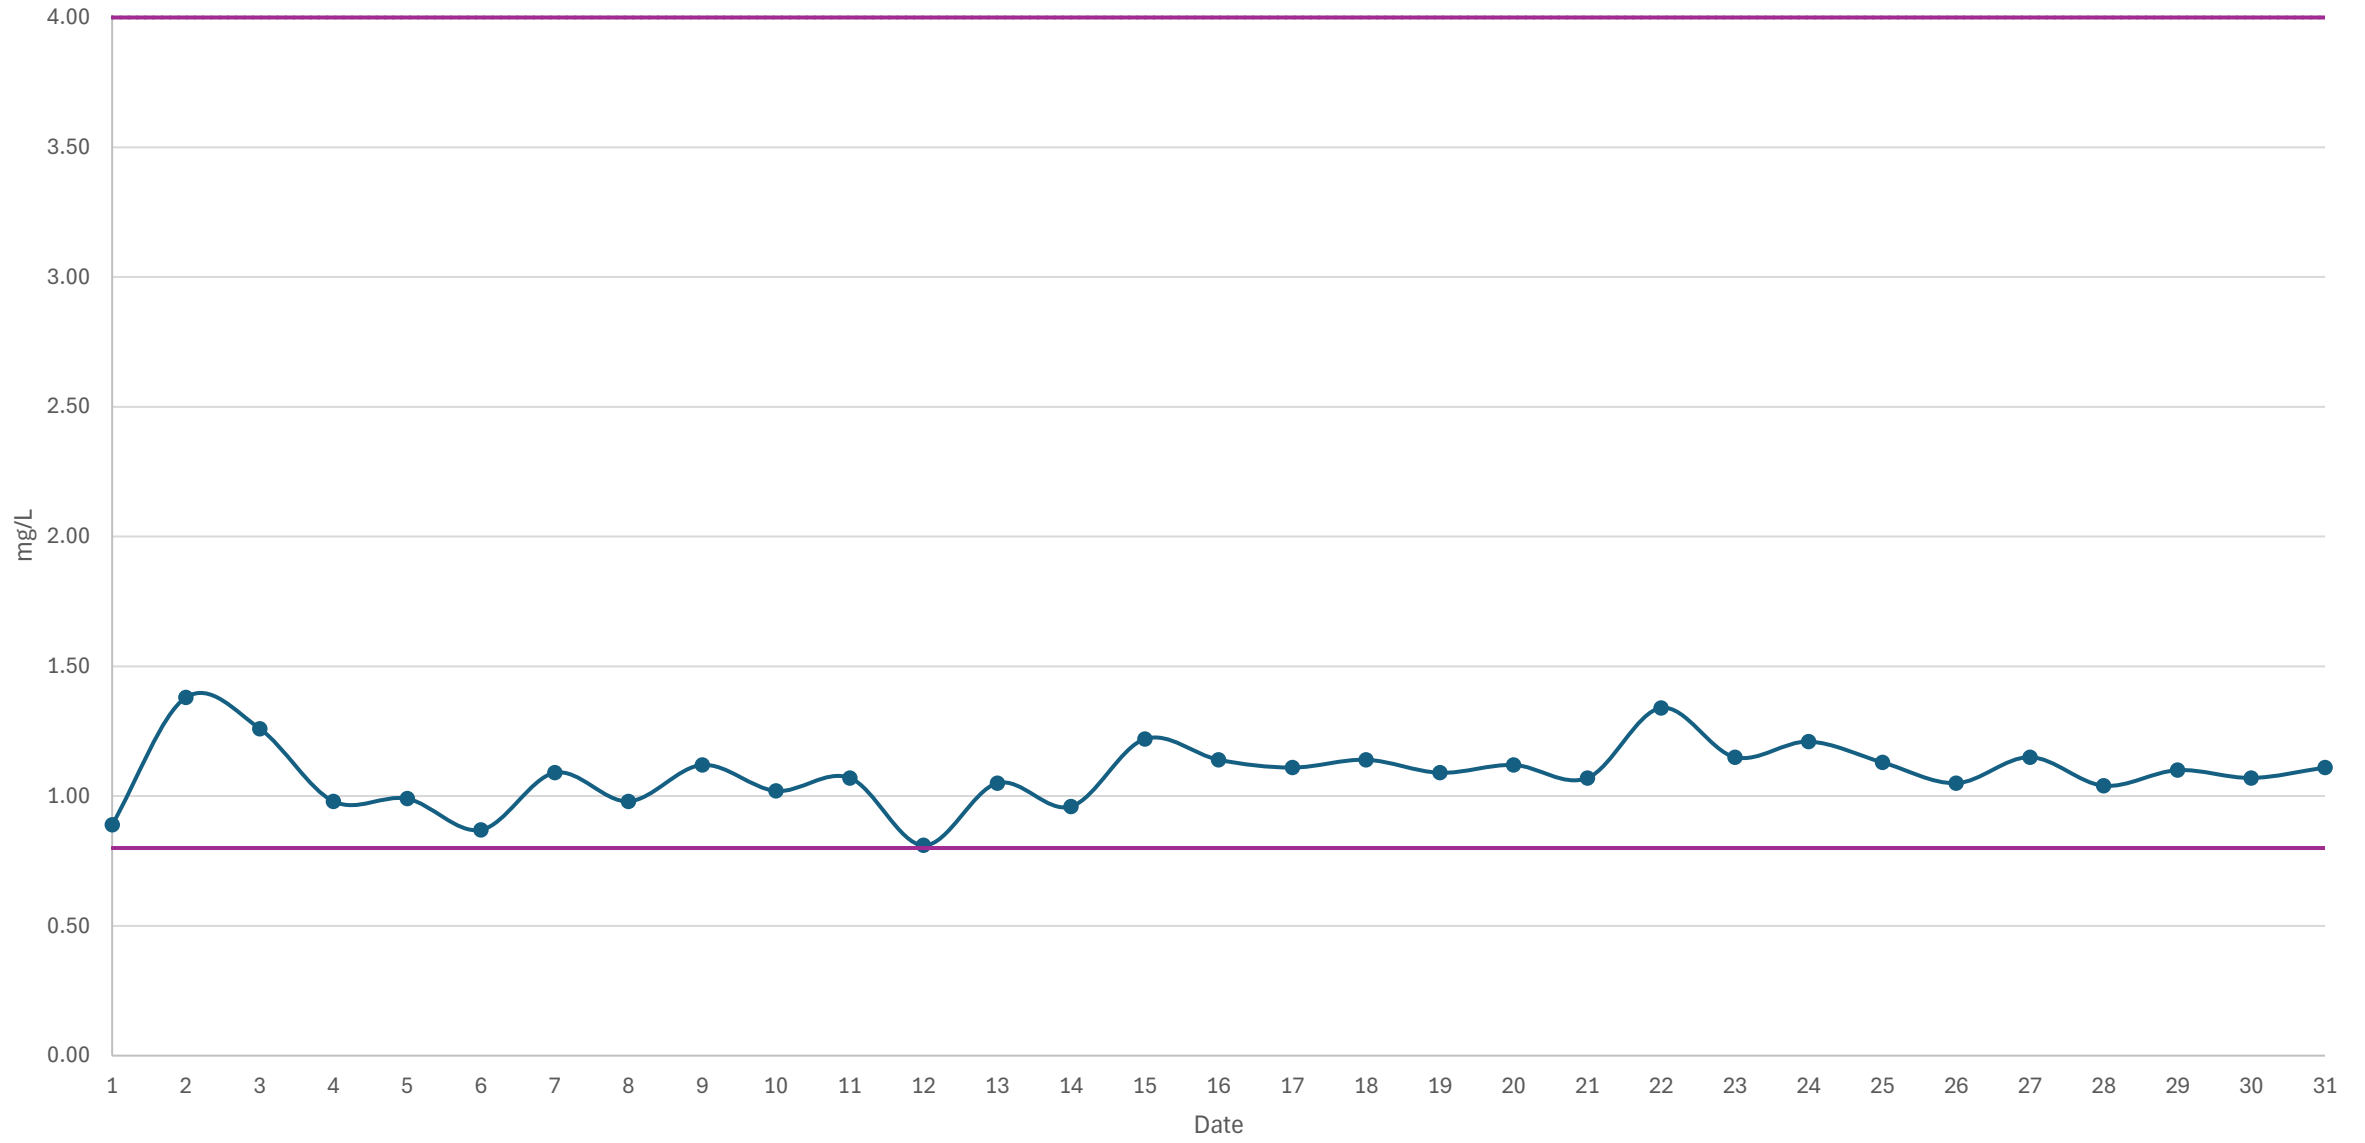

● System Free Chlorine — Chlorine permitted min (0.8) and max (4.0)

Waterhouse pH March 2026

