

Vermont Monthly Operations Report For Groundwater Systems
And Systems Purchasing Groundwater

Feb.

2026

Name of System: Richmond Water Resources Department

WSID # : 5084 Town : Richmond

Brad Snow Operator, Phone work--> 434 - 2178 Phone home--> 316-2326

A master meter is installed and functioning which records daily production

All water quality compliance analysis results have been reported to the Water Supply Division.

See attached for production information and results of daily parameter testing.

I certify, as the owner or authorized representative of this Water System, that I have completed this form, or reviewed it if completed by another, and that I have taken the necessary steps to ensure the information shown is correct. In making this certification, I understand that civil and/or criminal penalties may be imposed for submitting false information.

Prepared by Brad Snow, Class 3 Public Water System Operator # OP05111

Signature  Date 3/5/26

Approved by Josh Arneson, Richmond Town Manager and Authorized Representative


Signature  Date 3/9/26

Notes:

Richmond Water Resources Department
VERMONT GROUNDWATER SYSTEM #5084 DAILY TEST RESULTS Month **Feb-26**


Date	Meter	gallons produced	Finished Water Entering System			Endyne FL Result
			FL Lev	Entry Point Free CL2	PH Out	On Date Sampled
Sample Location			Waterhouse Tap	Waterhouse Tap	Waterhouse Tap	From The
Target Range			0.6 - 1.0 mg/L	0.8 - 4.0 mg/L	Minimum of 7.0	Waterhouse Tap 0.6-1.0 mg/L
Jan. 31 #->	25,873,400					
1	25,875,400	2,000	0.76	1.23	7.49	
2	25,972,600	97,200	0.74	1.40	7.48	
3	26,016,200	43,600	0.74	1.37	7.45	
4	26,080,600	64,400	0.76	1.33	7.44	0.75
5	26,156,700	76,100	0.83	1.36	7.44	
6	26,162,500	5,800	0.88	1.28	7.46	
7	26,298,800	136,300	0.86	1.24	7.43	
8	26,306,300	7,500	0.84	1.31	7.47	
9	26,364,700	58,400	0.71	1.67	7.50	
10	26,454,500	89,800	0.86	1.31	7.45	0.83
11	26,506,300	51,800	0.89	1.10	7.44	
12	26,531,500	25,200	0.87	0.94	7.42	
13	26,643,300	111,800	0.86	1.00	7.46	
14	26,694,400	51,100	0.81	1.01	7.44	
15	26,754,600	60,200	0.91	0.96	7.46	
16	26,827,100	72,500	0.85	1.08	7.45	
17	26,833,700	6,600	0.91	0.91	7.46	
18	26,972,900	139,200	0.92	1.10	7.43	
19	26,972,900	0	0.88	0.95	7.44	
20	27,102,000	129,100	1.00	1.01	7.43	
21	27,213,600	111,600	0.88	0.97	7.43	
22	27,189,000	-24,600	1.00	1.16	7.45	
23	27,240,700	51,700	0.66	1.14	7.44	
24	27,240,700	0	0.82	1.00	7.45	
25	27,350,600	109,900	0.74	1.11	7.47	
26	27,350,600	0	0.76	1.04	7.48	
27	27,416,700	66,100	0.71	1.23	7.49	
28	27,460,800	44,100	0.74	1.02	7.45	
Total		1,587,400				
Ave.		51,206	0.83	1.15	7.45	0.79
Max.		139,200	1.00	1.67	7.50	0.83
Min		-24,600	0.66	0.91	7.42	0.75

Fluoride in mg/L for February 2026

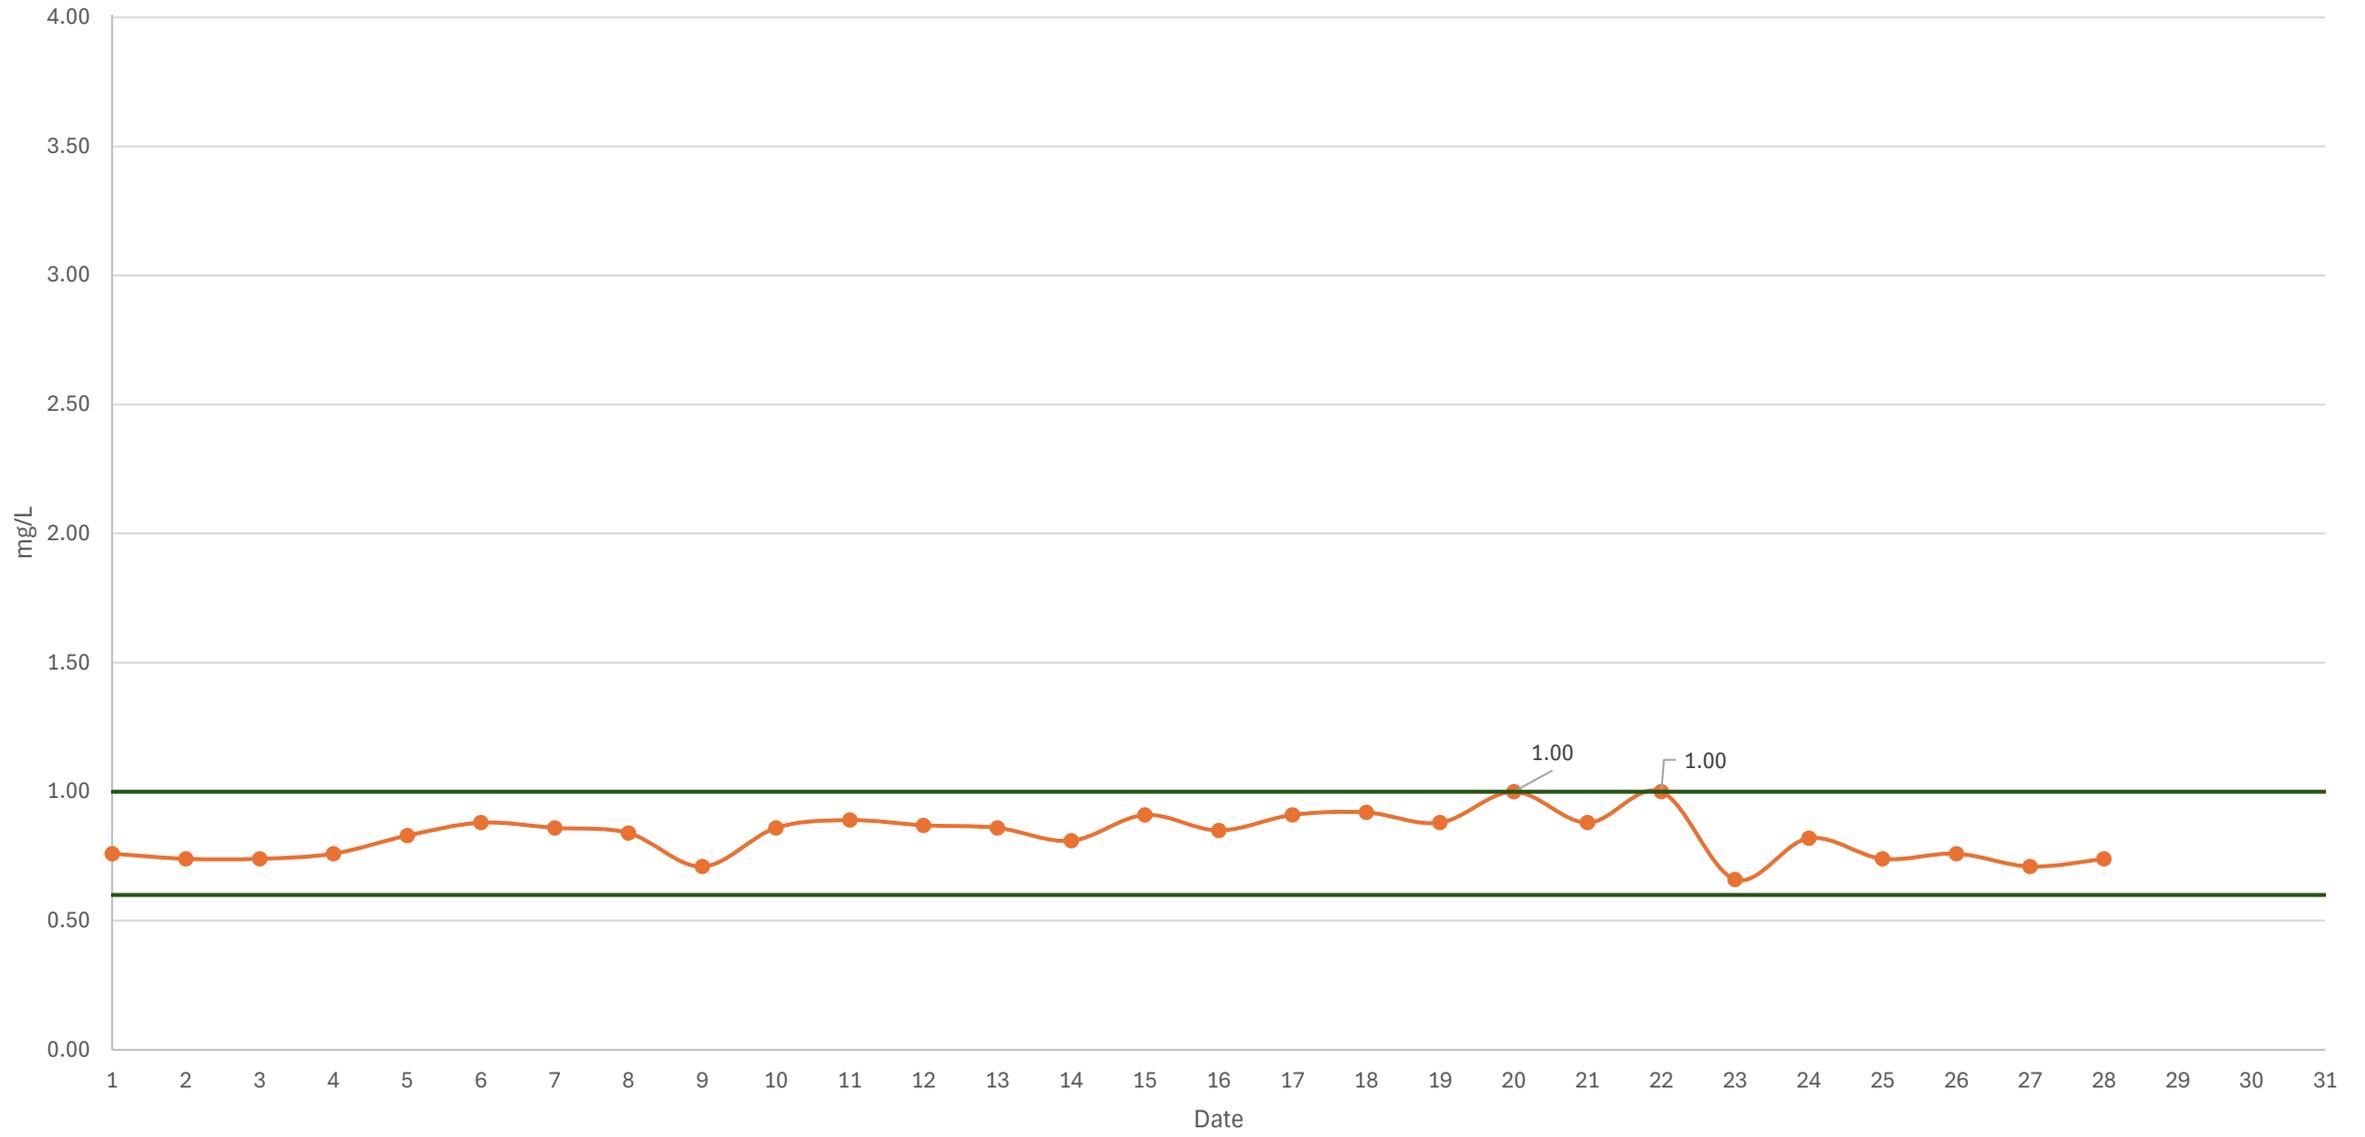

● Fluoride — Fluoride permitted min (0.6) and max (1.0)

System Free Chlorine in mg/L for February 2026

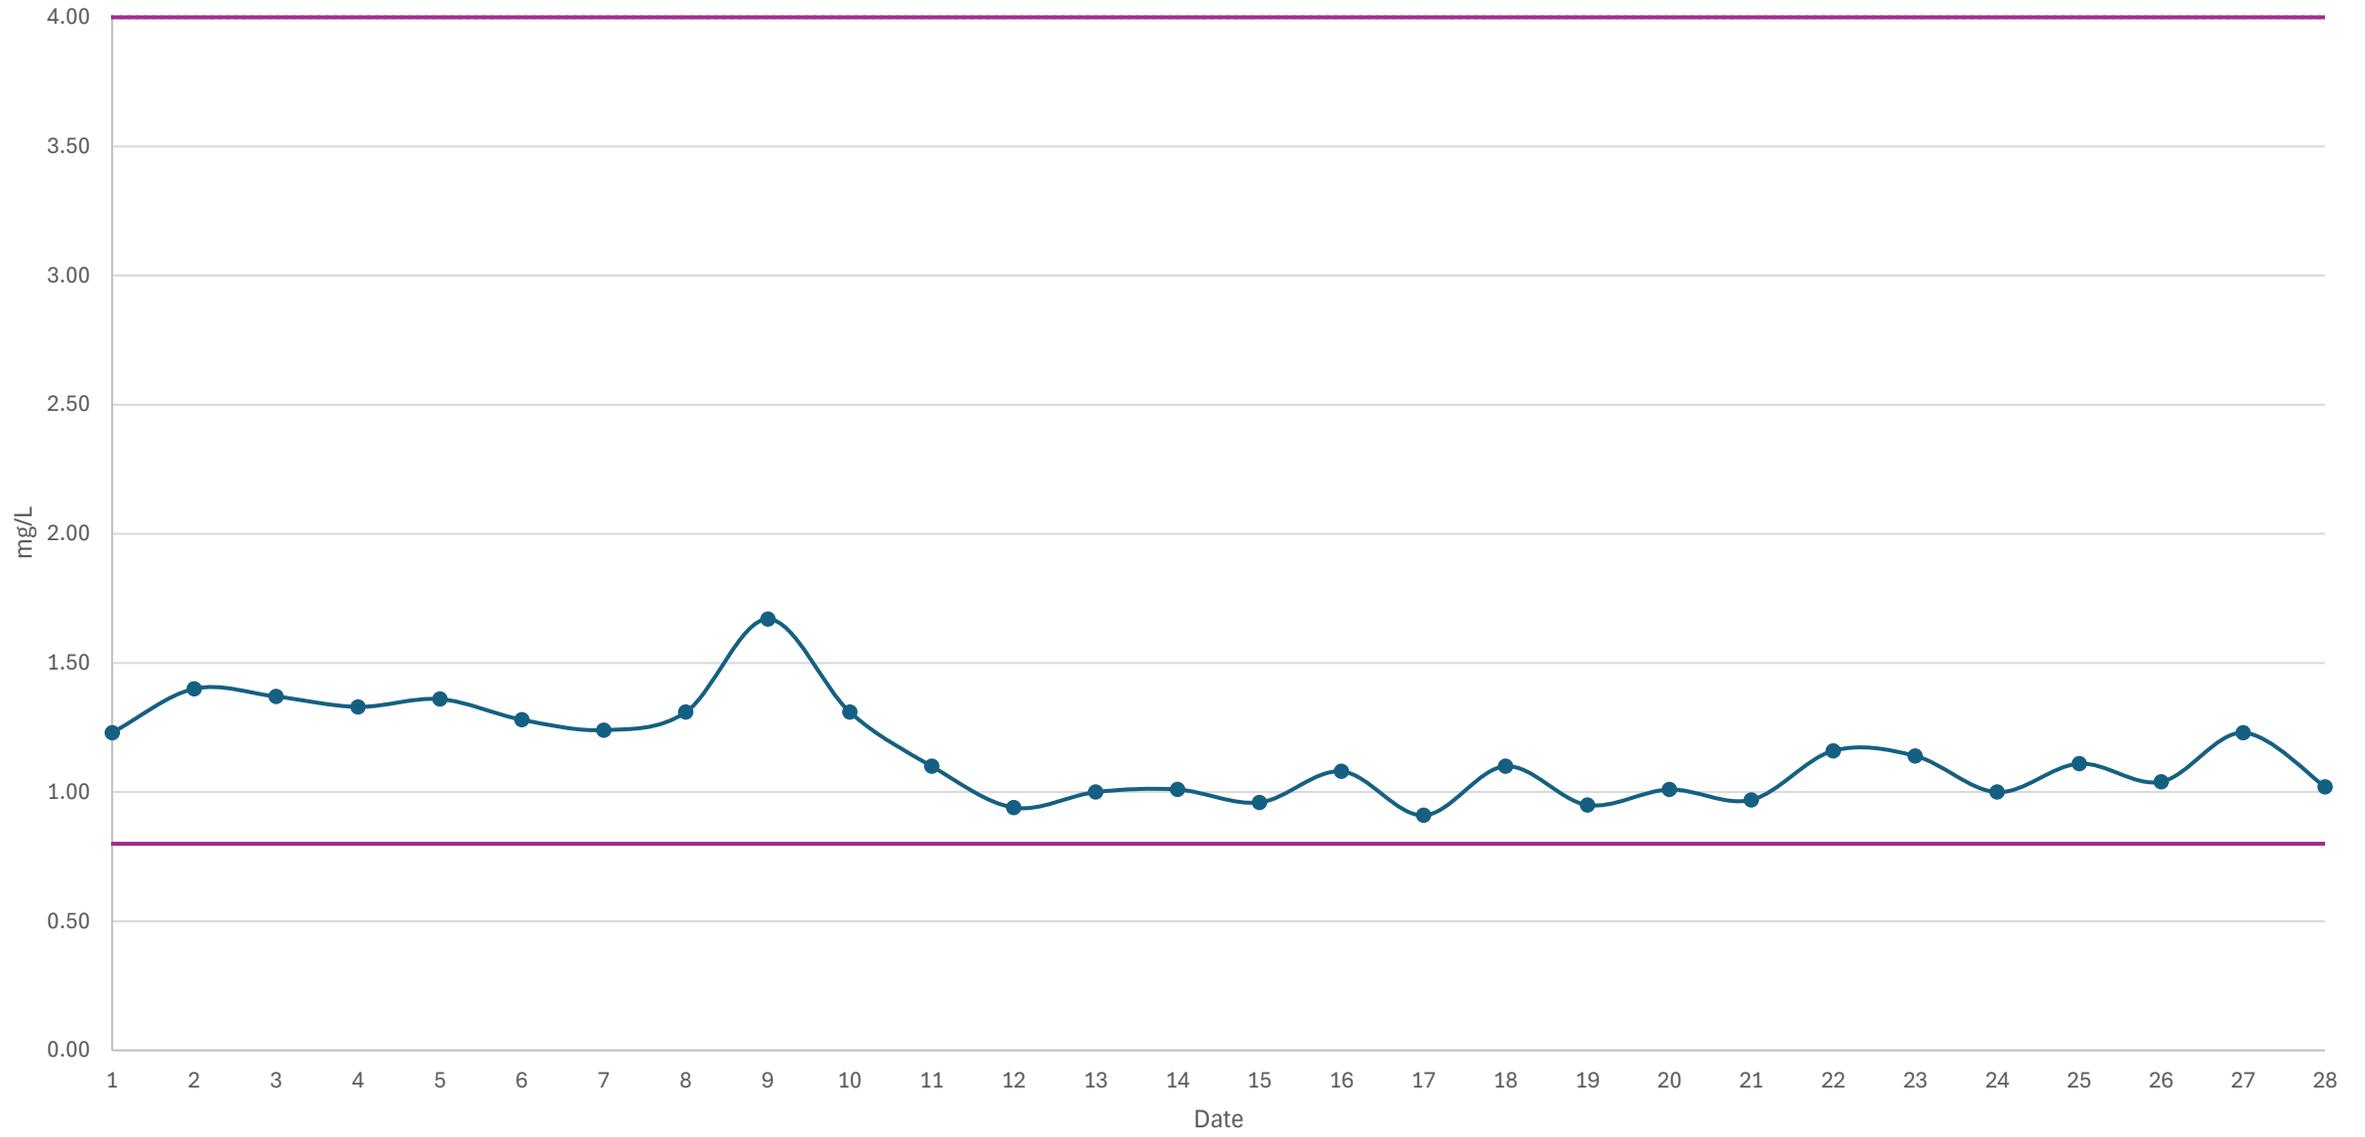

● System Free Chlorine — Chlorine permitted min (0.8) and max (4.0)

Waterhouse pH February 2026

