

Vermont Monthly Operations Report For Groundwater Systems  
And Systems Purchasing Groundwater

**Jan.**

**2026**

Name of System: Richmond Water Resources Department

WSID # : 5084    Town : Richmond

Brad Snow Operator, Phone work--> 434 - 2178 Phone home--> 316-2326

A master meter is installed and functioning which records daily production

All water quality compliance analysis results have been reported to the Water Supply Division.

See attached for production information and results of daily parameter testing.

I certify, as the owner or authorized representative of this Water System, that I have completed this form, or reviewed it if completed by another, and that I have taken the necessary steps to ensure the information shown is correct. In making this certification, I understand that civil and/or criminal penalties may be imposed for submitting false information.

Prepared by Brad Snow, Class 3 Public Water System Operator # OP05111

Signature  Date 2/2/26

Approved by Josh Arneson, Richmond Town Manager and Authorized Representative


Signature  Date 2/11/26

Notes:
--------

**Richmond Water Resources Department**  
**VERMONT GROUNDWATER SYSTEM #5084 DAILY TEST RESULTS**      Month      **Jan-26**


Date	Meter	gallons produced	Finished Water Entering System			Endyne FI Results
			FL Lev	Entry Point Free CL2	PH Out	
Sample Location			Waterhouse Tap	Waterhouse Tap	Waterhouse Tap	
Target Range			0.6 - 1.0 mg/L	0.8 - 4.0 mg/L	Minimum of 7.0	
December #:	24,010,300					
1	24,038,800	28,500	0.68	1.33	7.52	
2	24,123,600	84,800	0.69	1.12	7.51	
3	24,135,700	12,100	0.65	1.24	7.54	
4	24,258,100	122,400	0.73	1.47	7.50	
5	24,269,200	11,100	0.75	1.41	7.51	0.73
6	24,327,800	58,600	0.69	1.33	7.52	
7	24,426,100	98,300	0.79	1.37	7.43	
8	24,466,600	40,500	0.76	1.35	7.45	
9	24,534,300	67,700	0.77	1.32	7.45	
10	24,611,300	77,000	0.82	1.25	7.40	
11	24,619,900	8,600	0.76	1.19	7.41	
12	24,732,300	112,400	0.74	1.46	7.49	
13	24,750,000	17,700	0.71	1.21	7.47	
14	24,840,400	90,400	0.72	1.53	7.42	
15	24,908,300	67,900	0.70	1.43	7.41	
16	24,945,400	37,100	0.71	1.22	7.46	0.63
17	25,047,100	101,700	0.67	1.09	7.47	
18	25,067,400	20,300	0.77	1.21	7.43	
19	25,161,600	94,200	0.69	1.42	7.42	
20	25,184,400	22,800	0.77	1.36	7.44	
21	25,257,800	73,400	0.70	1.35	7.42	
22	25,331,700	73,900	0.75	1.17	7.42	
23	25,344,400	12,700	0.76	1.10	7.41	
24	25,463,900	119,500	0.64	1.38	7.46	
25	25,463,900	0	0.71	1.40	7.49	
26	25,589,500	125,600	0.73	1.46	7.46	
27	25,592,300	2,800	0.74	1.49	7.47	
28	25,666,500	74,200	0.72	1.45	7.47	
29	25,675,300	8,800	0.72	1.43	7.47	
30	25,752,000	76,700	0.78	1.11	7.47	
31	25,873,400	121,400	0.75	1.29	7.47	
<b>Total</b>		1,863,100				
<b>Ave.</b>		60,100	0.73	1.32	7.46	
<b>Max.</b>		125,600	0.82	1.53	7.54	
<b>Min</b>		0	0.64	1.09	7.40	

Fluoride in mg/L for January 2026

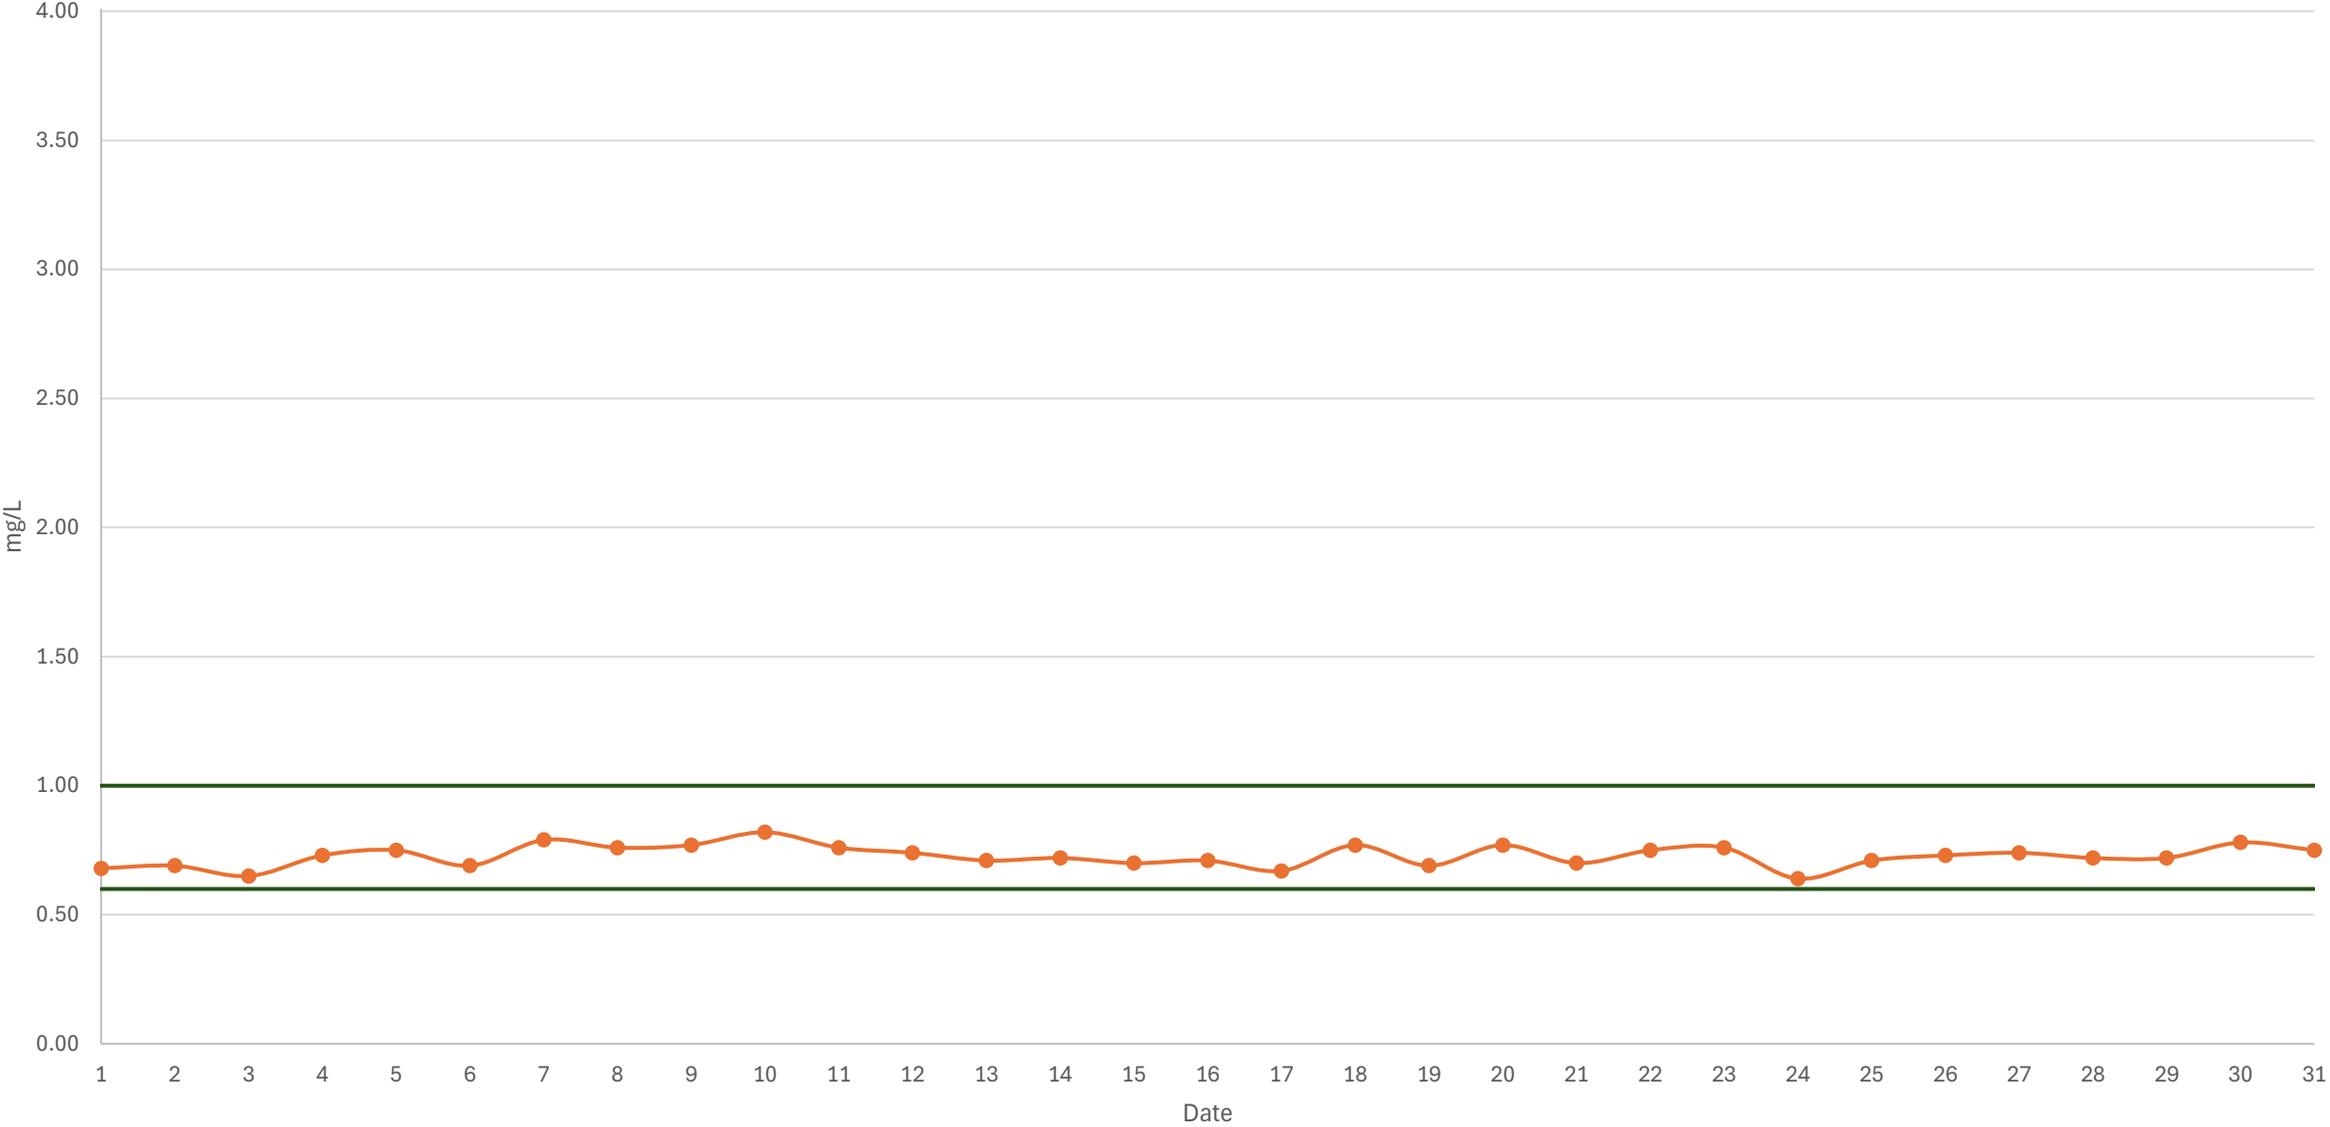

—●— Fluoride — Fluoride permitted min (0.6) and max (1.0)

System Free Chlorine in mg/L for January 2026

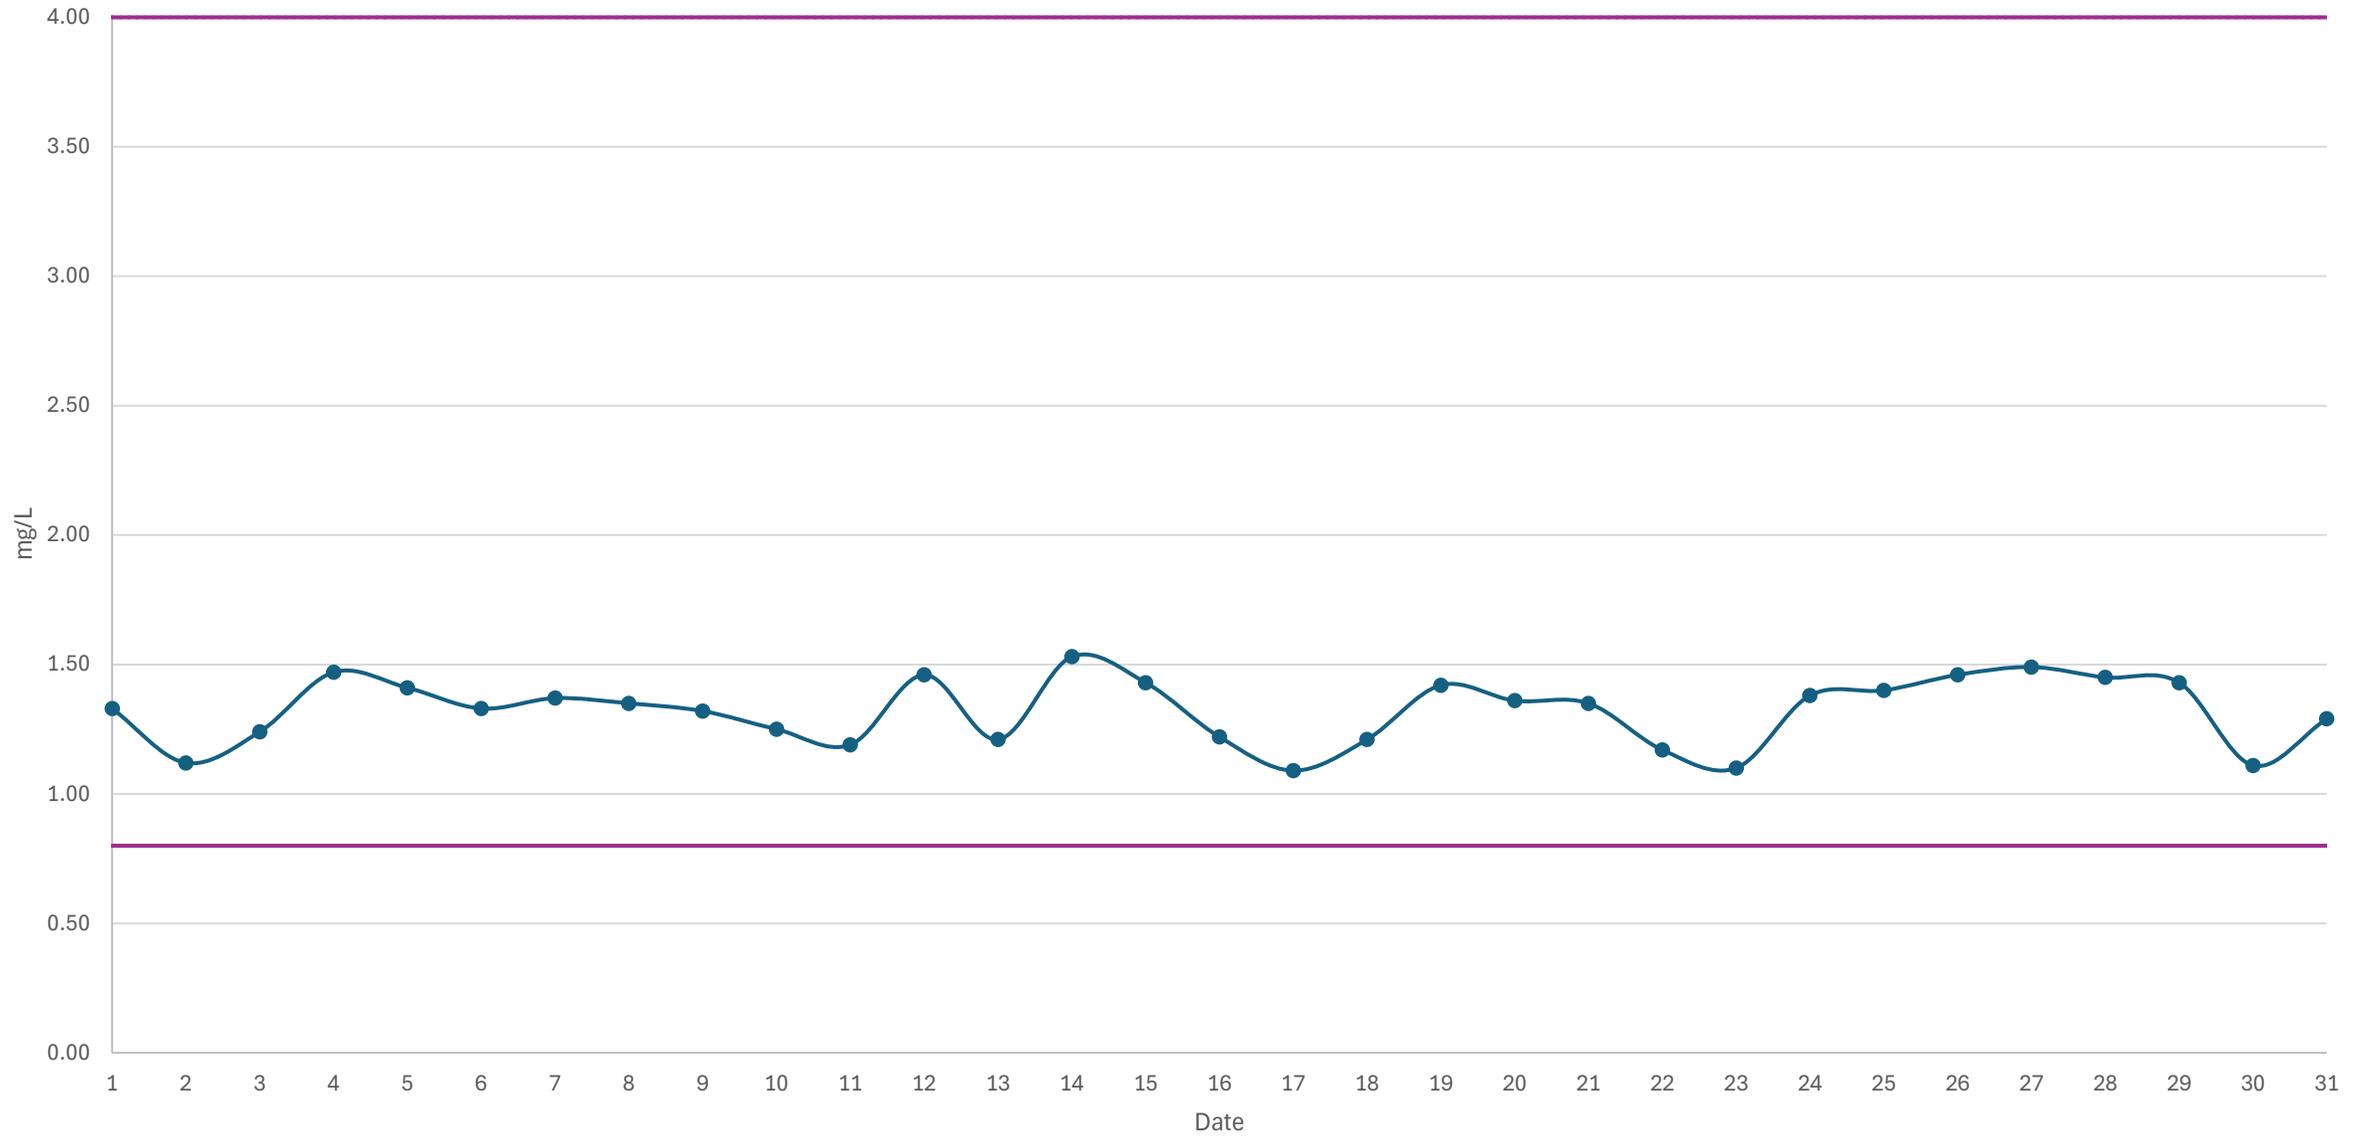

● System Free Chlorine    — Chlorine permitted min (0.8) and max (4.0)

Waterhouse pH January 2026

