

Richmond Water Resources Department						
VERMONT GROUNDWATER SYSTEM #5084 DAILY TEST RESULTS				Month	Jun-26	
			Finished Water Entering System			Endyne FL Result
Date	Meter	gallons produced	FL Lev	Entry Point Free CL2	PH Out	On Date Sampled
Sample Location			Waterhouse Tap	Waterhouse Tap	Waterhouse Tap	From The
						Waterhouse Tap
Target Range			0.6 - 1.0 mg/L	0.8 - 4.0 mg/L	Minimum of 7.0	0.6-1.0 mg/L
May 31 #->	32,163,200					
1	32,230,000	66,800	0.63	1.19	7.35	0.52
2	32,278,100	48,100	0.63	1.07	7.35	
3	32,337,000	58,900	0.53	1.13	7.35	
4	32,408,100	71,100	0.46	1.06	7.30	
5	32,442,600	34,500	0.49	1.18	7.33	
6	32,535,000	92,400	0.65	1.11	7.31	
7	32,544,800	9,800	0.64	0.66	7.35	
8	32,634,200	89,400	0.62	1.15	7.34	
9	32,657,900	23,700	0.60	0.96	7.32	
10	32,777,500	119,600	0.66	2.13	7.30	
11	32,777,500	0	0.57	2.17	7.32	
12	32,873,900	96,400	0.76	1.70	7.27	
13	32,914,200	40,300	0.76	1.47	7.29	
14	33,027,000	112,800	0.74	1.42	7.27	
15	33,027,000	0	0.77	1.29	7.30	
16	33,079,800	52,800	0.78	1.23	7.33	0.74
17	33,156,000	76,200	0.69	1.13	7.33	
18	33,190,500	34,500	0.69	1.41	7.30	
19	33,262,700	72,200	0.69	1.34	7.30	
20	33,262,700	0	0.72	1.26	7.33	
21	33,357,600	94,900	0.67	1.19	7.32	
22	33,363,300	5,700	0.65	1.18	7.34	
23	33,421,700	58,400	0.67	1.39	7.32	
24	33,479,500	57,800	0.65	1.23	7.32	
25	33,599,400	119,900	0.75	1.29	7.32	
26	33,612,300	12,900	0.71	1.25	7.33	
27	33,702,000	89,700	0.71	1.54	7.30	
28	33,702,000	0	0.67	1.27	7.29	
29	33,721,800	19,800	0.70	1.38	7.31	
30	33,730,500	8,700	0.73	1.34	7.30	
Total		1,567,300				
Ave.		50,558	0.67	1.30	7.32	0.63
Max.		119,900	0.78	2.17	7.35	0.74
Min		0	0.46	0.66	7.27	0.52

Vermont Monthly Operations Report For Groundwater Systems
And Systems Purchasing Groundwater

June

2026

Name of System: Richmond Water Resources Department

WSID # : 5084 Town : Richmond

Erin Kelley, Operator, Phone work--> 802 316 7559

A master meter is installed and functioning which records daily production

All water quality compliance analysis results have been reported to the Water Supply Division.

See attached for production information and results of daily parameter testing.

I certify, as the owner or authorized representative of this Water System, that I have completed this form, or reviewed it if completed by another, and that I have taken the necessary steps to ensure the information shown is correct. In making this certification, I understand that civil and/or criminal penalties may be imposed for submitting false information.

Prepared by Erin S. Kelley, Class 3 Public Water System Operator # OP05524


Signature Erin Kelley Date 07/08/2026

Approved by Josh Arneson, Richmond Town Manager and Authorized Representative


Signature Josh Arneson Date 7/9/26

Notes:

Fluoride in mg/L for June 2026

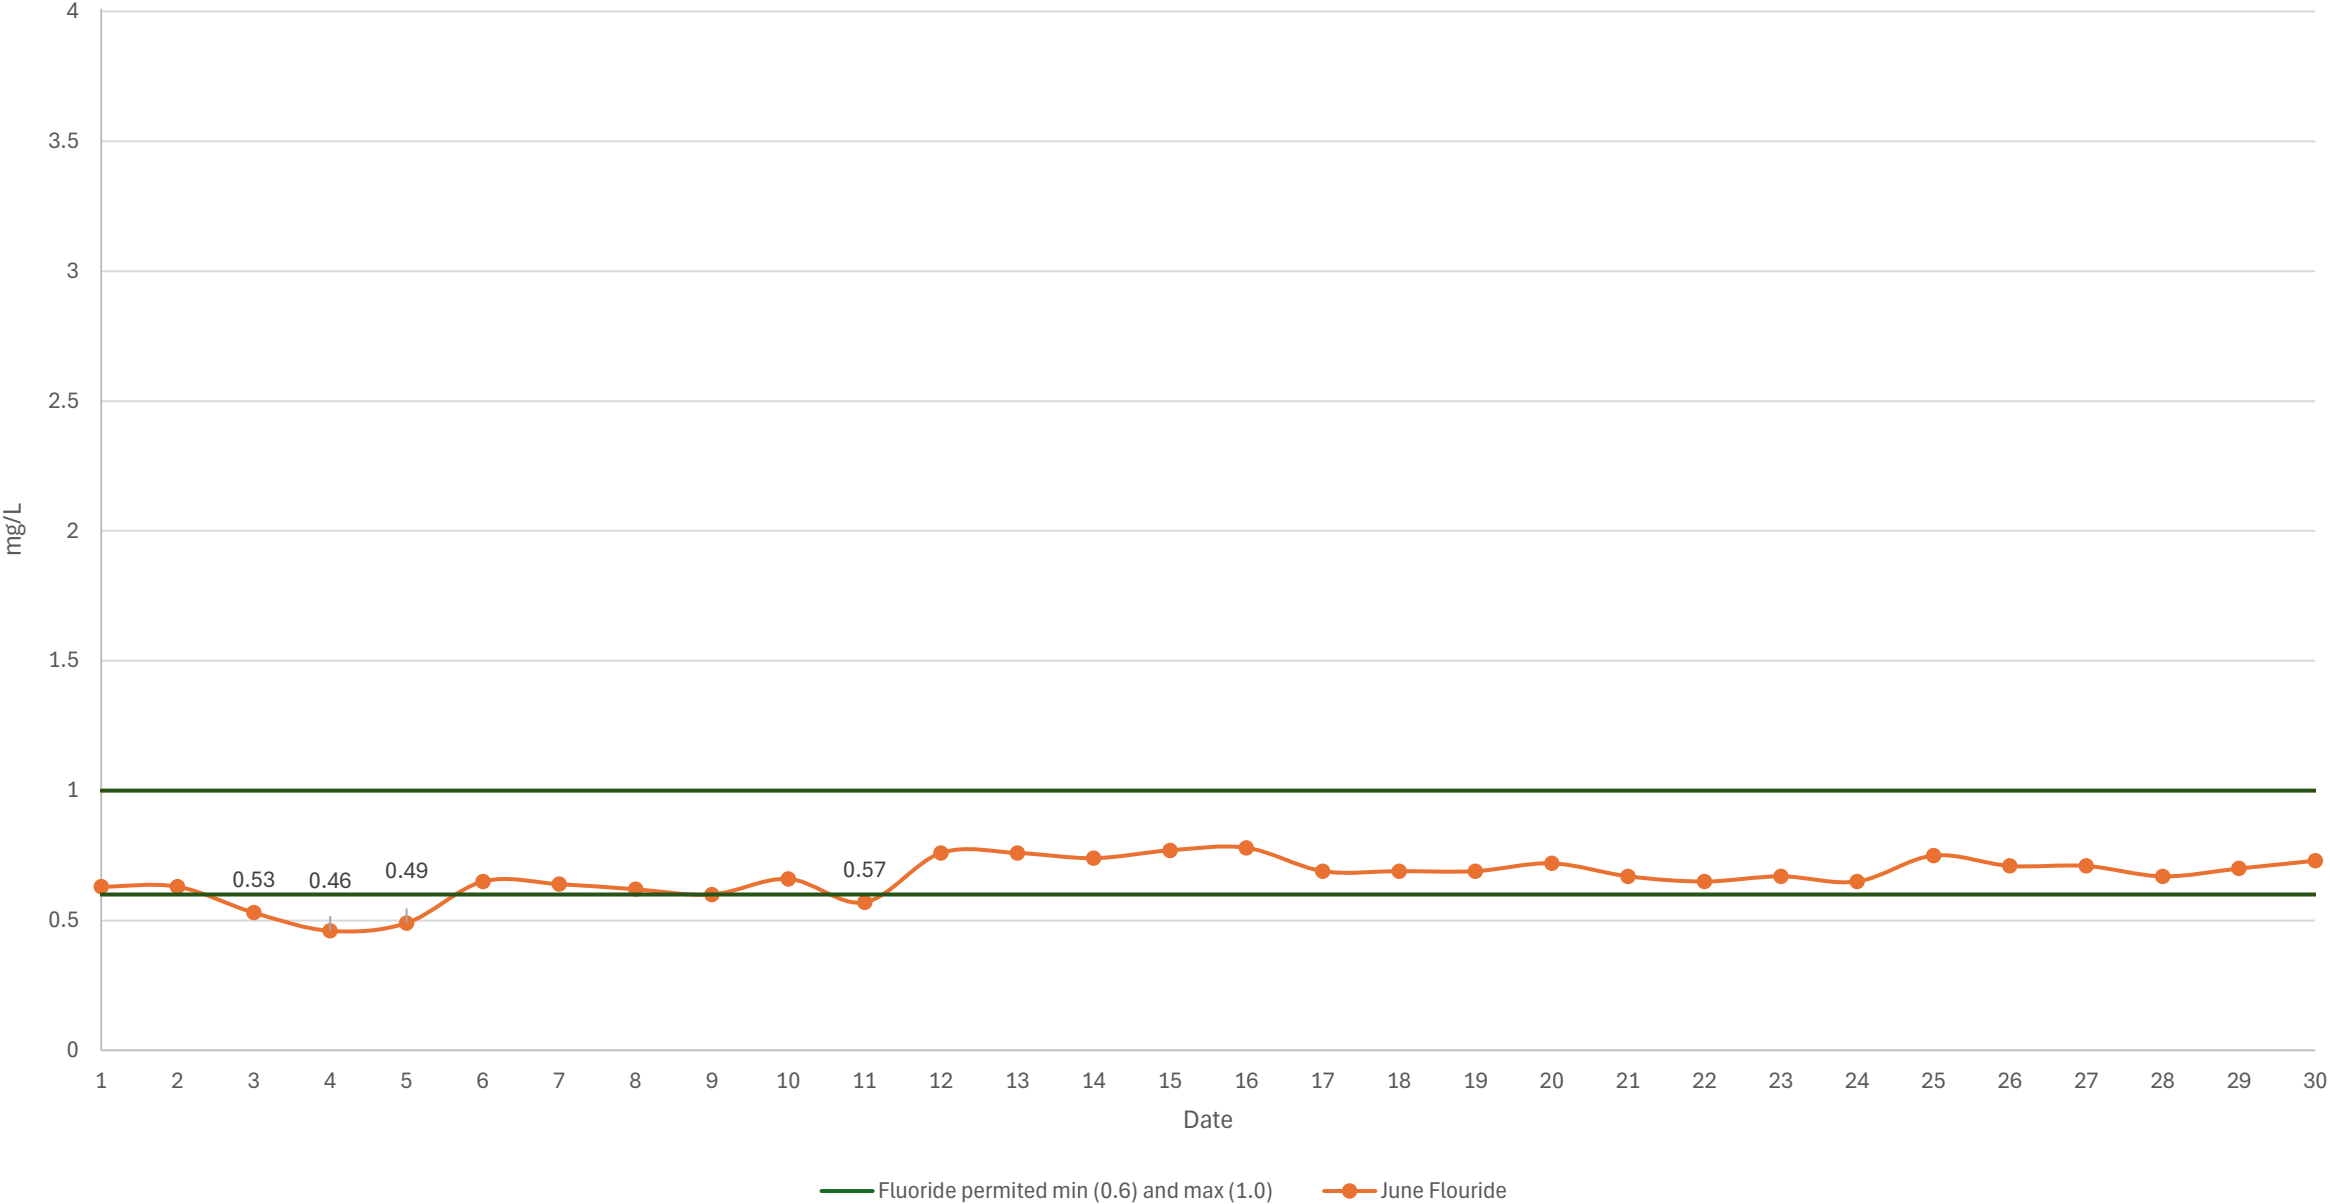

System Free Chlorine in mg/L for June 2026

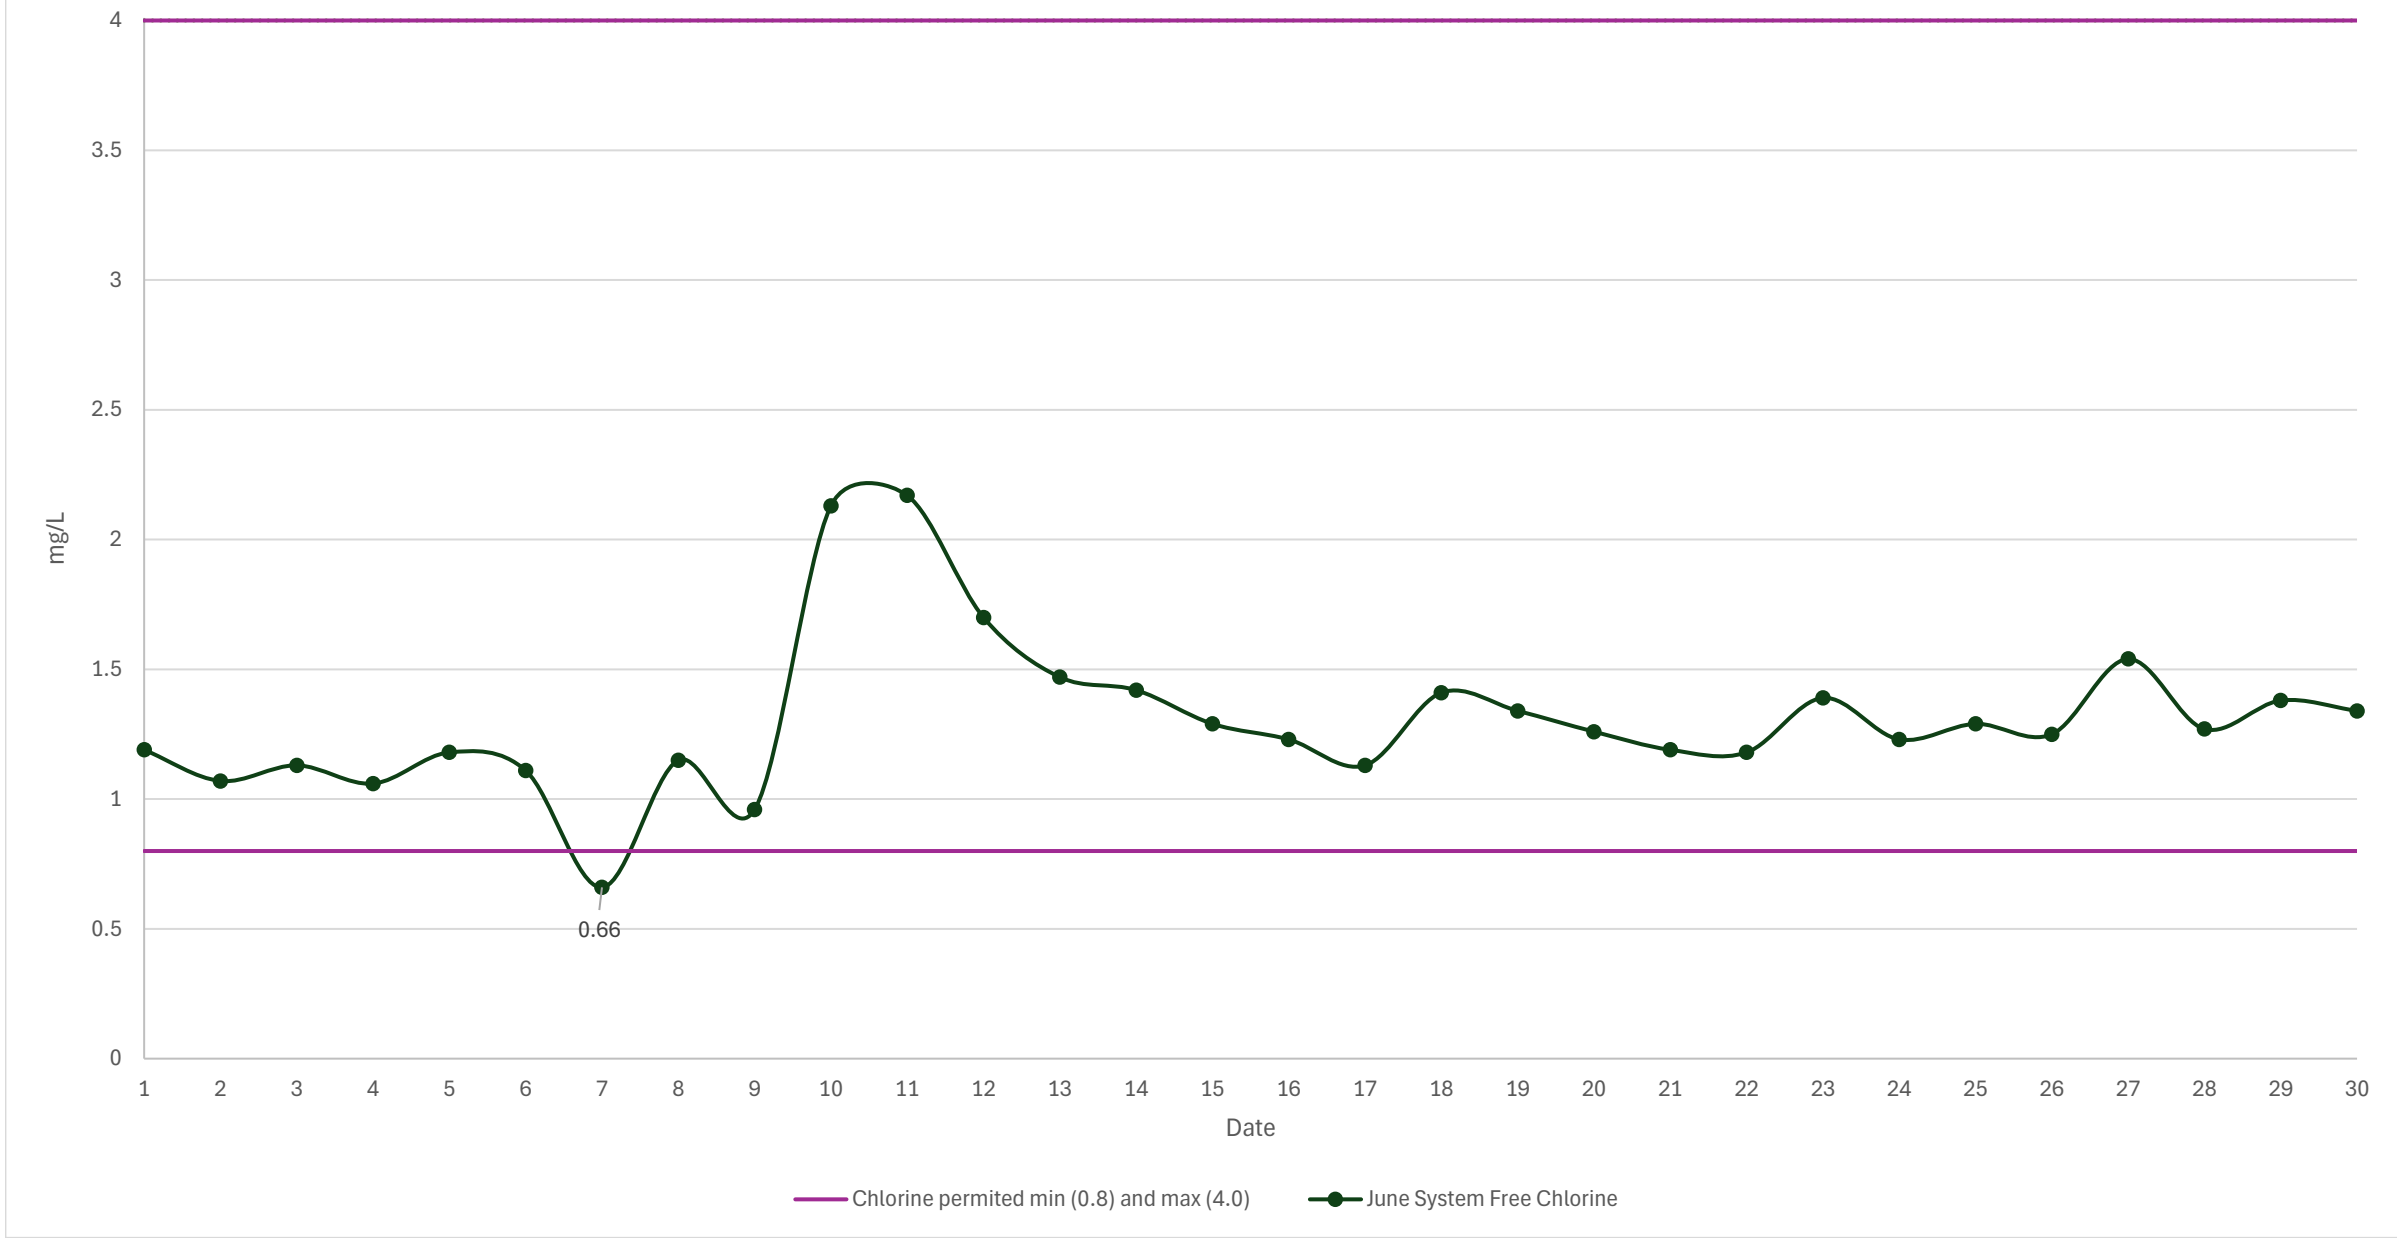

Waterhouse pH June 2026

