

Richmond Water Resources Department
VERMONT GROUNDWATER SYSTEM #5084 DAILY TEST RESULTS Month Aug-26

		gallons produced	Finished Water Entering System			Endyne FL Result
Date	Meter		FL Lev	Entry Point Free CL2	PH Out	On Date Sampled
Sample Location			Waterhouse Tap	Waterhouse Tap	Waterhouse Tap	From The
						Waterhouse Tap
Target Range			0.6 - 1.0 mg/L	0.8 - 4.0 mg/L	Minimum of 7.0	0.6-1.0 mg/L
July 31 #->	35,615,200					
1	35,615,200	0	0.84	1.22	7.38	
2	35,700,200	85,000	0.88	1.35	7.35	
3	35,716,500	16,300	0.77	1.23	7.36	0.7
4	35,731,100	14,600	0.86	1.22	7.40	
5	35,833,600	102,500	0.78	1.31	7.36	
6	35,833,600	0	0.84	1.09	7.38	
7	35,936,600	103,000	0.85	1.31	7.32	
8	35,939,800	3,200	0.79	0.93	7.35	
9	36,010,800	71,000	0.82	1.23	7.33	
10	36,037,900	27,100	0.80	1.25	7.36	
11	36,048,800	10,900	0.82	1.14	7.39	0.69
12	36,151,100	102,300	0.72	1.31	7.37	
13	36,151,100	0	0.82	1.16	7.39	
14	36,239,800	88,700	0.84	1.39	7.39	
15	36,255,500	15,700	0.72	1.16	7.39	
16	36,305,700	50,200	0.81	1.26	7.41	
17	36,360,600	54,900	0.79	1.25	7.38	
18	36,360,600	0	0.77	1.10	7.39	
19	36,453,500	92,900	0.80	1.26	7.38	
20	36,464,100	10,600	0.79	1.20	7.40	
21	36,557,300	93,200	0.76	1.19	7.42	
22	36,572,700	15,400	0.85	1.02	7.42	
23	36,660,400	87,700	0.82	1.12	7.39	
24	36,674,500	14,100	0.73	1.06	7.40	
25	36,749,100	74,600	0.88	1.17	7.41	
26	36,794,700	45,600	0.90	1.06	7.41	
27	36,840,500	45,800	0.82	1.15	7.38	
28	36,913,000	72,500	0.87	1.06	7.39	
29	36,965,800	52,800	0.86	1.37	7.44	
30	37,016,700	50,900	0.84	0.94	7.42	
31	37,016,700	0	0.81	0.93	7.42	
Total		1,401,500				
Ave.		45,210	0.81	1.18	7.39	0.695
Max.		103,000	0.90	1.39	7.44	0.70
Min		0	0.72	0.93	7.32	0.69

Vermont Monthly Operations Report For Groundwater Systems
And Systems Purchasing Groundwater

August

2026

Name of System: Richmond Water Resources Department

WSID # : 5084 Town : Richmond

Erin Kelley, Operator, Phone work--> 802 316 7559

A master meter is installed and functioning which records daily production

All water quality compliance analysis results have been reported to the Water Supply Division.

See attached for production information and results of daily parameter testing.

I certify, as the owner or authorized representative of this Water System, that I have completed this form, or reviewed it if completed by another, and that I have taken the necessary steps to ensure the information shown is correct. In making this certification, I understand that civil and/or criminal penalties may be imposed for submitting false information.

Prepared by Erin S. Kelley, Class 3 Public Water System Operator # OP05524

Signature *Erin Kelley* Date 08/31/2026

Approved by Josh Arneson, Richmond Town Manager and Authorized Representative


Signature *Josh DA* Date 9/2/2026

Notes:

Fluoride in mg/L for August 2026



System Free Chlorine in mg/L for August 2026

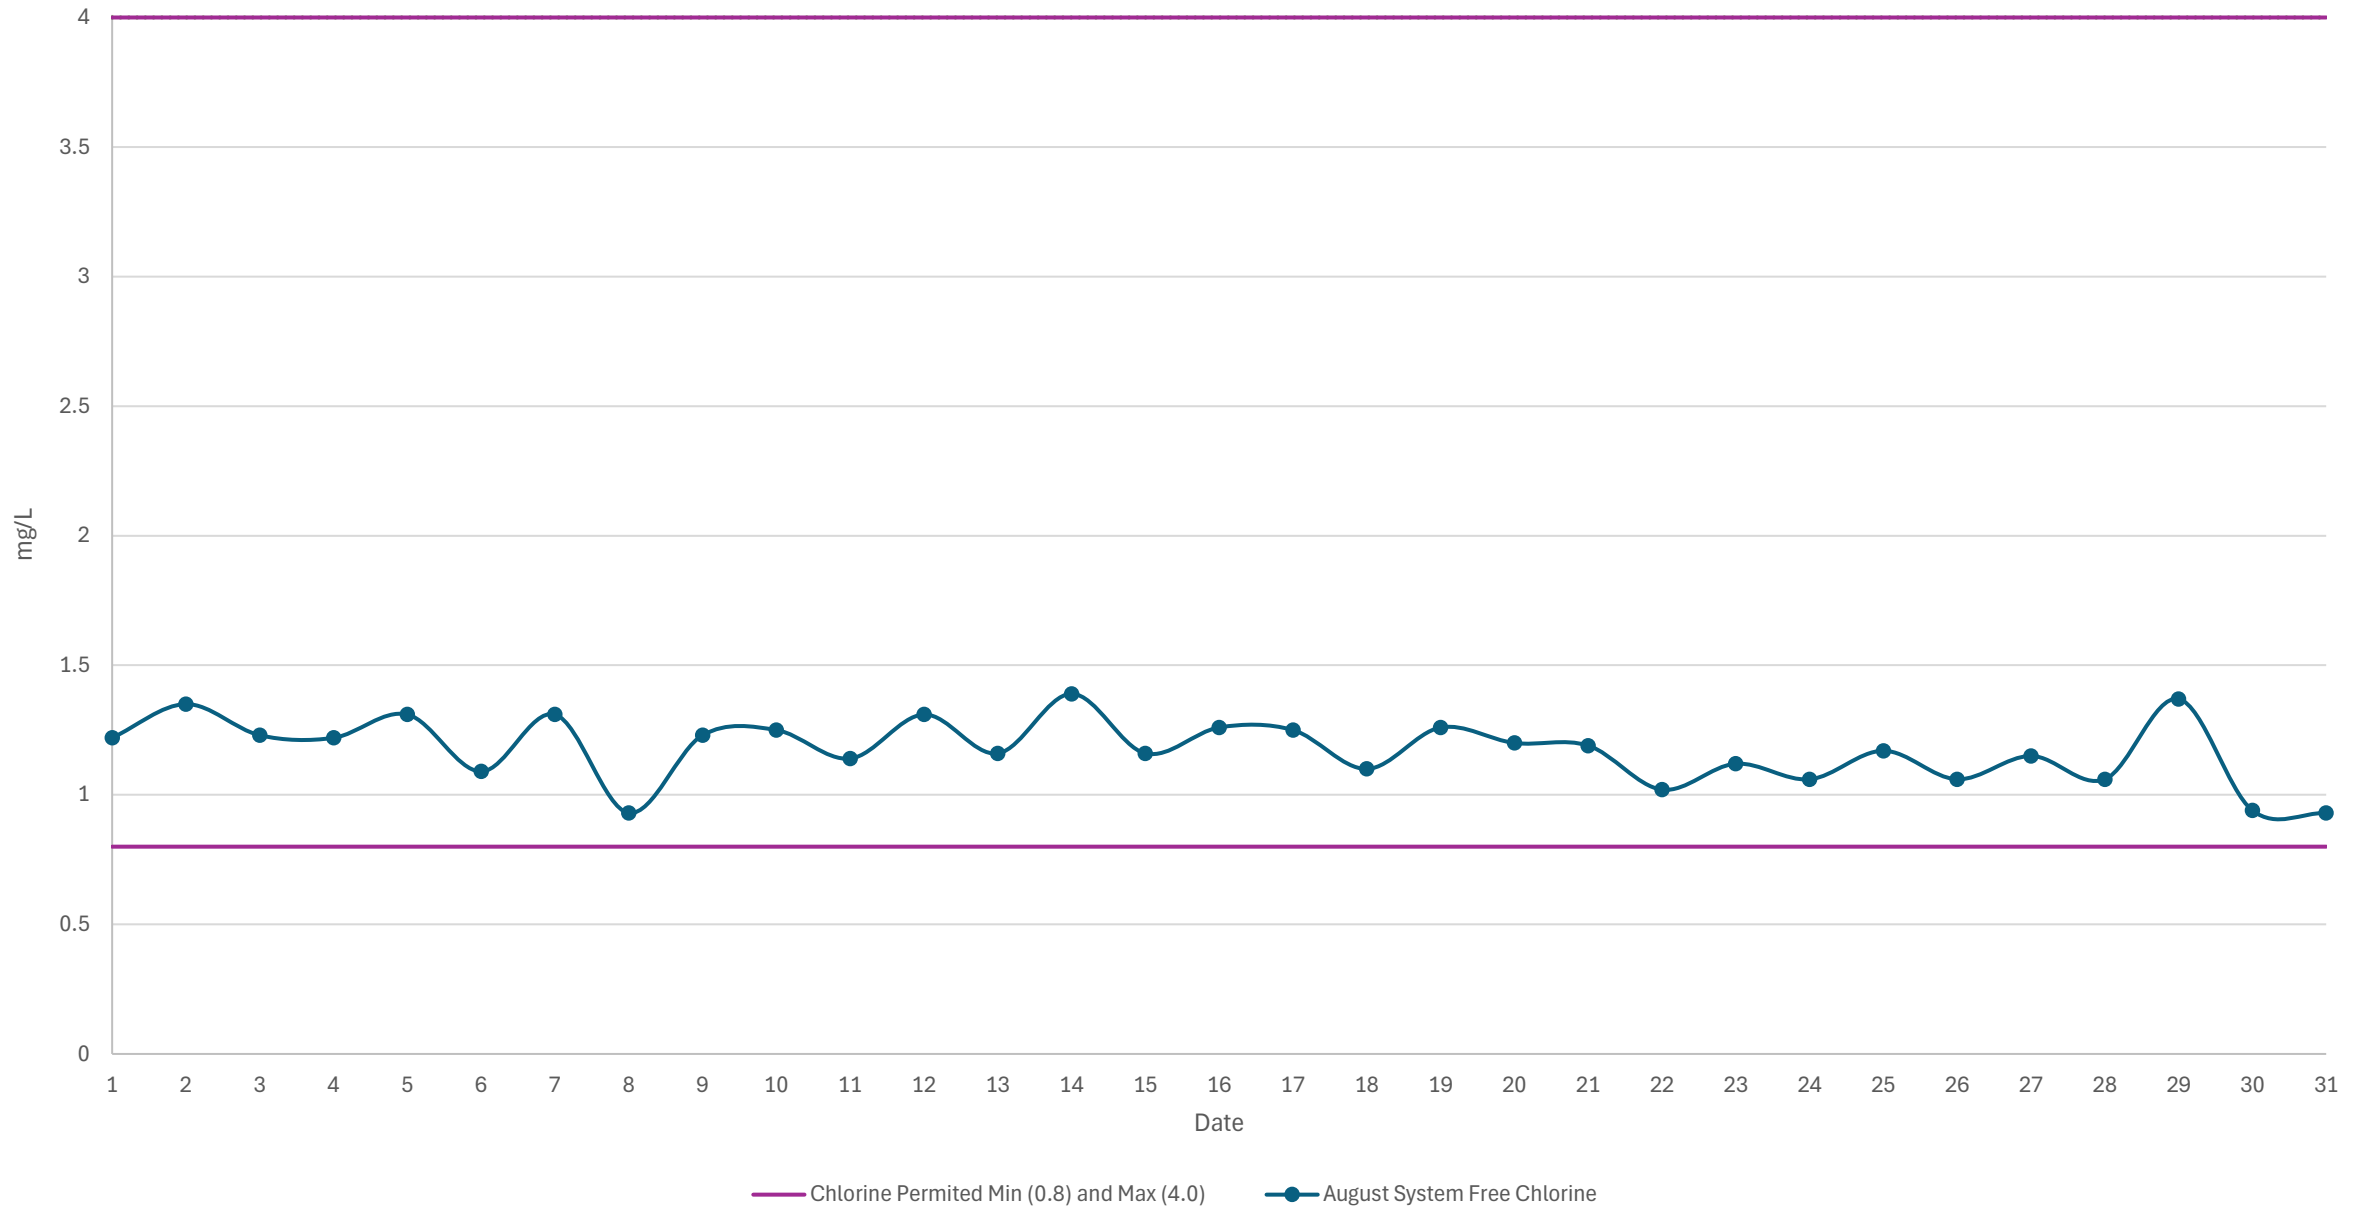

Waterhouse pH August 2026

