

Richmond Water Resources Department
VERMONT GROUNDWATER SYSTEM #5084 DAILY TEST RESULTS Month **Sep-26**

		gallons produced	Finished Water Entering System			Endyne FL Result
Date	Meter		FL Lev	Entry Point Free CL2	PH Out	On Date Sampled
Sample Location			Waterhouse Tap	Waterhouse Tap	Waterhouse Tap	From The
						Waterhouse Tap
Target Range			0.6 - 1.0 mg/L	0.8 - 4.0 mg/L	Minimum of 7.0	0.6-1.0 mg/L
Aug 31 #->	37,016,700					
1	37,131,000	114,300	0.83	1.26	7.41	0.73
2	37,164,900	33,900	0.81	1.13	7.42	
3	37,223,600	58,700	0.88	1.33	7.41	
4	37,281,400	57,800	0.85	0.93	7.40	
5	37,299,000	17,600	0.83	1.21	7.42	
6	37,388,300	89,300	0.78	1.07	7.42	0.66
7	37,452,000	63,700	0.79	0.87	7.42	
8	37,508,100	56,100	0.86	1.15	7.43	
9	37,540,500	32,400	0.78	0.84	7.42	
10	37,625,100	84,600	0.83	1.03	7.38	
11	37,664,600	39,500	0.96	0.31	7.41	
12	37,718,300	53,700	0.92	1.14	7.48	
13	37,718,300	0	0.92	0.97	7.43	
14	37,802,400	84,100	0.93	1.10	7.44	
15	37,802,400	0	0.94	1.20	7.47	
16	37,829,400	27,000	0.91	1.18	7.47	
17	37,893,100	63,700	0.87	1.19	7.43	
18	37,939,500	46,400	0.80	1.11	7.42	
19	37,955,300	15,800	0.84	1.14	7.50	
20	38,047,600	92,300	0.83	1.22	7.50	
21	38,047,600	0	0.86	0.99	7.53	
22	38,125,800	78,200	0.82	1.51	7.50	
23	38,141,000	15,200	0.82	1.42	7.40	
24	38,187,100	46,100	0.83	1.36	7.47	
25	38,298,700	111,600	0.88	1.35	7.49	
26	38,366,000	67,300	0.83	1.33	7.48	
27	38,366,000	0	0.75	1.27	7.48	
28	38,445,600	79,600	0.82	1.58	7.46	
29	38,490,700	45,100	0.84	1.45	7.48	
30	38,555,400	64,700	0.77	1.64	7.47	
Total		1,538,700				
Ave.		49,635	0.85	1.18	7.45	0.695
Max.		114,300	0.96	1.64	7.53	0.73
Min		0	0.75	0.31	7.38	0.66

Vermont Monthly Operations Report For Groundwater Systems
And Systems Purchasing Groundwater

Sept 2026

Name of System: Richmond Water Resources Department

WSID # : 5084 Town : Richmond

Erin Kelley, Operator, Phone work--> 802 316 7559

A master meter is installed and functioning which records daily production

All water quality compliance analysis results have been reported to the Water Supply Division.

See attached for production information and results of daily parameter testing.

I certify, as the owner or authorized representative of this Water System, that I have completed this form, or reviewed it if completed by another, and that I have taken the necessary steps to ensure the information shown is correct. In making this certification, I understand that civil and/or criminal penalties may be imposed for submitting false information.

Prepared by Erin S. Kelley, Class 3 Public Water System Operator # OP05524

Signature Erin Kelley Date 09/30/26

Approved by Josh Arneson, Richmond Town Manager and Authorized Representative


Signature Josh DA Date 10/2/26

Notes:

Fluoride in mg/L for September 2026



System Free Chlorine in mg/L for September 2026

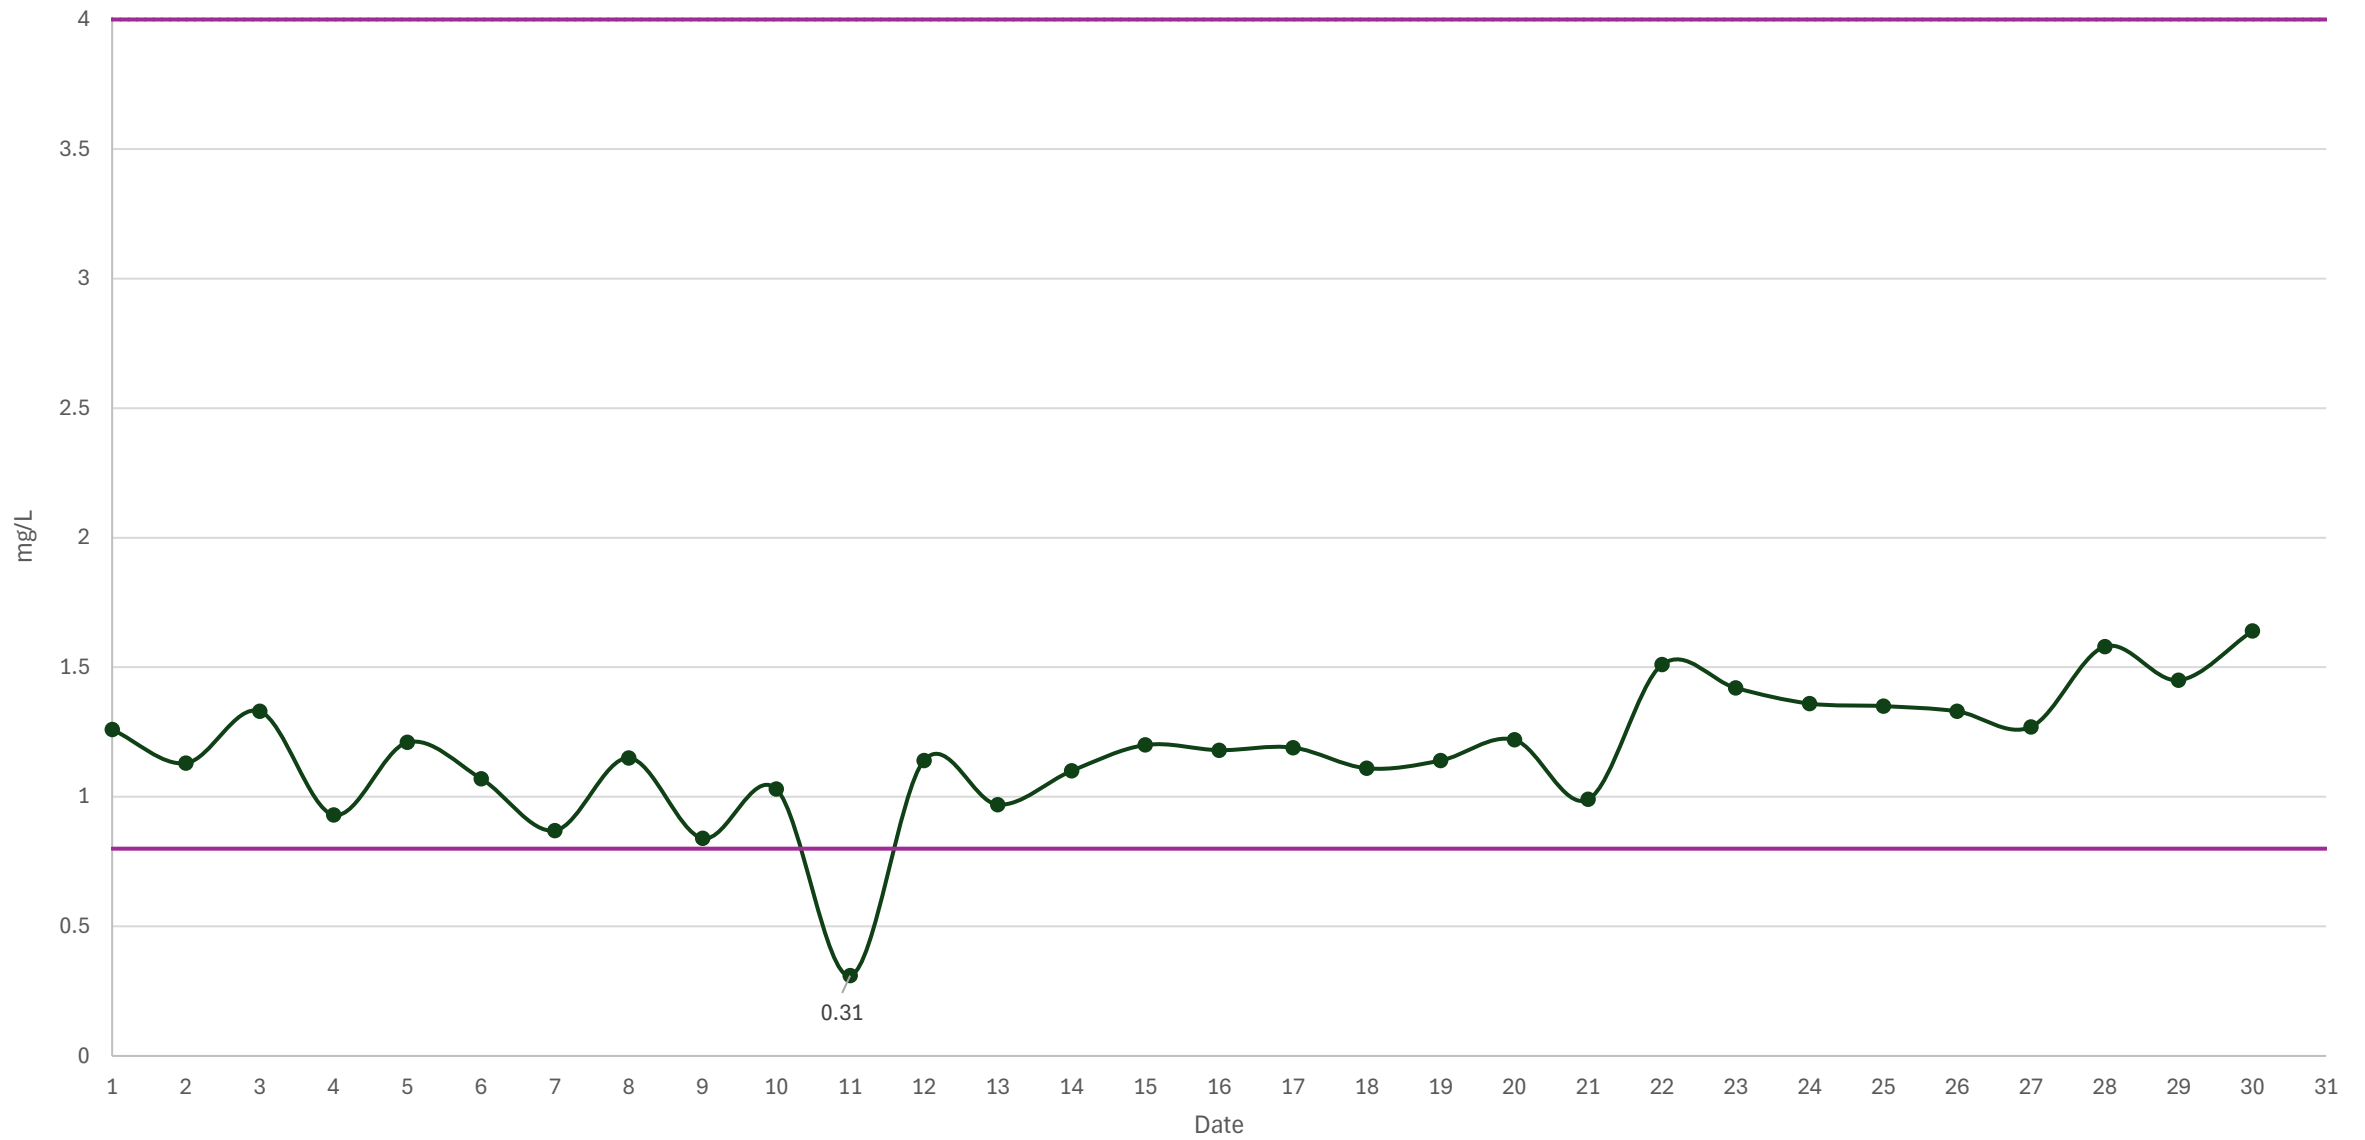

Chlorine Permitted Min (0.8) and Max (4.0) September Free Chlorine

Waterhouse pH September 2026

